

SECTION 312319 - DEWATERING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes construction dewatering.
- B. Related Requirements:
 - 1. Section 312000 "Earth Moving" for excavating, backfilling, site grading, and controlling surface-water runoff and ponding.

1.3 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For Installer.
- B. Existing Conditions: Using photographs or video recordings, show existing conditions of adjacent construction and site improvements that might be misconstrued as damage caused by dewatering operations. Submit before Work begins
- C. Record Drawings: Identify locations and depths of capped wells and well points and other abandoned-in-place dewatering equipment.

1.4 ACTION SUBMITTALS

- A. Shop Drawings: Dewatering silt/sedimentation traps/bags.

1.5 QUALITY ASSURANCE

- A. Installer Qualifications: An experienced installer with 3 or more years of related experience that has specialized in design of dewatering systems and dewatering work.

1.6 FIELD CONDITIONS

- A. Project-Site Information: A geotechnical report has been prepared for this Project and is available for information only. The opinions expressed in this report are those of a geotechnical engineer and represent interpretations of subsoil conditions, tests, and results of analyses

conducted by a geotechnical engineer. Owner is not responsible for interpretations or conclusions drawn from this data.

1. Make additional test borings and conduct other exploratory operations necessary for dewatering according to the performance requirements.
2. The geotechnical report is included elsewhere in Project Manual.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Dewatering Performance: Design, furnish, install, test, operate, monitor, and maintain dewatering system of sufficient scope, size, and capacity to control hydrostatic pressures and to lower, control, remove, and dispose of ground water and permit excavation and construction to proceed on dry, stable subgrades.
 1. Continuously monitor and maintain dewatering operations to ensure erosion control, stability of excavations and constructed slopes, prevention of flooding in excavation, and prevention of damage to subgrades and permanent structures.
 2. Prevent surface water from entering excavations by grading, dikes, or other means.
 3. Accomplish dewatering without damaging existing buildings, structures, and site improvements adjacent to excavation.
 4. Remove dewatering system when no longer required for construction.
- B. Regulatory Requirements: Comply with governing EPA notification regulations before beginning dewatering. Comply with water- and debris-disposal regulations of authorities having jurisdiction.

2.2 DEWATERING SEDIMENT BAG

- A. Sized to accommodate dewatering system capacity. Rated for 80 microns detaining both oil and sediment/silt.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Protect structures, utilities, sidewalks, pavements, and other facilities from damage caused by settlement, lateral movement, undermining, washout, and other hazards created by dewatering operations.
 1. Prevent surface water and subsurface or ground water from entering excavations, from ponding on prepared subgrades, and from flooding site or surrounding area.
 2. Protect subgrades and foundation soils from softening and damage by rain or water accumulation.

- B. Install dewatering system to ensure minimum interference with roads, streets, walks, and other adjacent occupied and used facilities.
 - 1. Do not close or obstruct streets, walks, or other adjacent occupied or used facilities without permission from Owner and authorities having jurisdiction. Provide alternate routes around closed or obstructed traffic ways if required by authorities having jurisdiction.
- C. Provide temporary grading to facilitate dewatering and control of surface water.
- D. Protect and maintain temporary erosion and sedimentation controls, during dewatering operations.

3.2 INSTALLATION

- A. Install dewatering system utilizing wells, well points, or similar methods complete with pump equipment, standby power and pumps, filter material gradation, valves, appurtenances, water disposal, and surface-water controls.
 - 1. Space well points or wells at intervals required to provide sufficient dewatering.
 - 2. Use filters or other means to prevent pumping of fine sands or silts from the subsurface.
- B. Place dewatering system into operation to lower water to specified levels before excavating below ground-water level.
- C. Provide sumps, sedimentation tanks, and other flow-control devices as required by authorities having jurisdiction.
- D. Provide standby equipment on-site, installed and available for immediate operation, to maintain dewatering on continuous basis if any part of system becomes inadequate or fails.

3.3 OPERATION

- A. Operate system continuously until drains, sewers, and structures have been constructed and fill materials have been placed or until dewatering is no longer required.
- B. Operate system to lower and control ground water to permit excavation, construction of structures, and placement of fill materials on dry subgrades. Drain water-bearing strata above and below bottom of foundations, drains, sewers, and other excavations.
 - 1. Do not permit open-sump pumping that leads to loss of fines, soil piping, subgrade softening, and slope instability.
 - 2. Reduce hydrostatic head in water-bearing strata below subgrade elevations of foundations, drains, sewers, and other excavations.
 - 3. Maintain piezometric water level a minimum of 24 inches below bottom of excavation.
- C. Dispose of water removed by dewatering in a manner that avoids endangering public health, property, and portions of work under construction or completed. Dispose of water and sediment in a manner that avoids inconvenience to others.

- D. Discharge shall be to a sediment filtering bag placed at the top of the concrete launch ramp. If the filter trap becomes loaded replace with a new one. Dispose of sediment captured at an off-site location in conformance with all applicable laws and regulations.
- E. Remove dewatering system from Project site on completion of dewatering. Plug or fill well holes with sand or cut off and cap wells a minimum of 36 inches below overlying construction.

3.4 FIELD QUALITY CONTROL

- A. Observation Wells: Provide observation wells or piezometers, take measurements, and maintain at least the minimum number indicated; additional observation wells may be required by authorities having jurisdiction.
 - 1. Observe and record daily elevation of ground water and piezometric water levels in observation wells.
 - 2. Repair or replace, within 24 hours, observation wells that become inactive, damaged, or destroyed. In areas where observation wells are not functioning properly, suspend construction activities until reliable observations can be made. Add or remove water from observation-well risers to demonstrate that observation wells are functioning properly.
 - 3. Fill observation wells, remove piezometers, and fill holes when dewatering is completed.
- B. Survey-Work Benchmarks: Resurvey benchmarks regularly during dewatering and maintain an accurate log of surveyed elevations for comparison with original elevations. Promptly notify Engineer if changes in elevations occur or if cracks, sags, or other damage is evident in adjacent construction.
- C. Provide continual observation to ensure that subsurface soils are not being removed by the dewatering operation.
- D. Prepare reports of observations.

3.5 PROTECTION

- A. Protect and maintain dewatering system during dewatering operations.
- B. Promptly repair damages to adjacent facilities caused by dewatering.

END OF SECTION 312319

SECTION 321216 - ASPHALT PAVING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:

1. Hot-mix asphalt paving.
2. Asphalt surface treatments.

- B. Related Requirements:

1. Section 024119 "Selective Demolition" for demolition and removal of existing asphalt pavement.
2. Section 312000 "Earth Moving" for subgrade preparation, fill material, separation geotextiles, unbound-aggregate subbase and base courses, and aggregate pavement shoulders.
3. Section 321313 "Concrete Paving" for concrete pavement and for separate concrete curbs, gutters, and driveway aprons.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.

1. Include technical data and tested physical and performance properties.
2. Job-Mix Designs: For each job mix proposed for the Work.

- B. HMA Plant Certification: Provide copy of most recent certification for proposed plant and intended mix.

1.4 QUALITY ASSURANCE

- A. Manufacturer Qualifications: A paving-mix manufacturer registered with and approved by Michigan Department of Transportation.

- B. Testing Agency Qualifications: Qualified according to ASTM D 3666 for testing indicated.

- C. Regulatory Requirements: Comply with materials, workmanship, and other applicable requirements of the MDOT 2012 Standard Specification for Construction for asphalt paving work.

1. Measurement and payment provisions and safety program submittals included in standard specifications do not apply to this Section.

1.5 FIELD CONDITIONS

- A. Environmental Limitations: Do not apply asphalt materials if subgrade is wet or excessively damp, if rain is imminent or expected before time required for adequate cure, or if the following conditions are not met:
 1. Prime Coat: Minimum surface temperature of 60 deg F.
 2. Tack Coat: Minimum surface temperature of 60 deg F.
 3. Slurry Coat: Comply with weather limitations in ASTM D 3910.
 4. Asphalt Base Course: Minimum surface temperature of 40 deg F and rising at time of placement.
 5. Asphalt Surface Course: Minimum surface temperature of 60 deg F at time of placement.

PART 2 - PRODUCTS

2.1 AGGREGATES

- A. General: Use materials and gradations that have performed satisfactorily in previous installations.
- B. Coarse Aggregate: ASTM D 692, sound; angular crushed stone, crushed gravel, or cured, crushed blast-furnace slag.
- C. Fine Aggregate: ASTM D 1073, sharp-edged natural sand or sand prepared from stone, gravel, cured blast-furnace slag, or combinations thereof.
 1. For hot-mix asphalt, limit natural sand to a maximum of 20 percent by weight of the total aggregate mass.
- D. Mineral Filler: ASTM D 242, rock or slag dust, hydraulic cement, or other inert material.

2.2 ASPHALT MATERIALS

- A. Asphalt Binder: ASTM D 6373 binder designation PG 58-34.
- B. Asphalt Cement: ASTM D 3381 for viscosity-graded material.
- C. Tack Coat: ASTM D 977 emulsified asphalt, or ASTM D 2397 cationic emulsified asphalt, slow setting, diluted in water, of suitable grade and consistency for application.
- D. Water: Potable.
- E. Undersealing Asphalt: ASTM D 3141; pumping consistency.

2.3 AUXILIARY MATERIALS

- A. Recycled Materials for Hot-Mix Asphalt Mixes: Reclaimed asphalt pavement; reclaimed, unbound-aggregate base material; and recycled tires or asphalt shingles from sources and gradations that have performed satisfactorily in previous installations, equal to performance of required hot-mix asphalt paving produced from all new materials.
- B. Herbicide: Commercial chemical for weed control, registered by the EPA, and not classified as "restricted use" for locations and conditions of application. Provide in granular, liquid, or wettable powder form.
- C. Sand: ASTM D 1073, Grade No. 2 or No. 3.
- D. Paving Geotextile: AASHTO M 288 paving fabric; nonwoven polypropylene; resistant to chemical attack, rot, and mildew; and specifically designed for paving applications.
- E. Joint Sealant: ASTM D 6690, Type II or III, hot-applied, single-component, polymer-modified bituminous sealant.

2.4 MIXES

- A. Hot-Mix Asphalt: Dense-graded, hot-laid, hot-mix asphalt plant mixes approved by authorities having jurisdiction and complying with the following requirements:
 - 1. Provide mixes with a history of satisfactory performance in geographical area where Project is located.
 - 2. Base Course: MDOT 13A or LVSP.
 - 3. Surface Course: MDOT 13A, 36A or LVSP..

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verify that subgrade is dry and in suitable condition to begin paving.
- B. Proceed with paving only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Protection: Provide protective materials, procedures, and worker training to prevent asphalt materials from spilling, coating, or building up on curbs, driveway aprons, manholes, and other surfaces adjacent to the Work.
- B. Proof-roll subgrade below pavements with heavy pneumatic-tired equipment to identify soft pockets and areas of excess yielding. Do not proof-roll wet or saturated subgrades.
 - 1. Completely proof-roll subgrade in one direction, repeating proof-rolling in direction perpendicular to first direction. Limit vehicle speed to 3 mph.

2. Proof roll with a loaded 10-wheel, tandem-axle dump truck weighing not less than 15 tons..
3. Excavate soft spots, unsatisfactory soils, and areas of excessive pumping or rutting, as determined by Engineer, and replace with compacted backfill or fill as directed.

3.3 SURFACE PREPARATION

- A. Immediately before placing asphalt materials, remove loose and deleterious material from substrate surfaces. Ensure that prepared subgrade is ready to receive paving.
- B. Tack Coat: Apply uniformly to surfaces of existing pavement at a rate of 0.05 to 0.15 gal./sq. yd..
 1. Allow tack coat to cure undisturbed before applying hot-mix asphalt paving.
 2. Avoid smearing or staining adjoining surfaces, appurtenances, and surroundings. Remove spillages and clean affected surfaces.

3.4 PLACING HOT-MIX ASPHALT

- A. Machine place hot-mix asphalt on prepared surface, spread uniformly, and strike off. Place asphalt mix by hand in areas inaccessible to equipment in a manner that prevents segregation of mix. Place each course to required grade, cross section, and thickness when compacted.
 1. Place hot-mix asphalt base course in number of lifts and thicknesses indicated.
 2. Place hot-mix asphalt surface course in single lift.
 3. Spread mix at a minimum temperature of 250 deg F.
 4. Place HMA if the surface temperature is at least 40 deg. F.
 5. Begin applying mix along centerline of crown for crowned sections and on high side of one-way slopes unless otherwise indicated.
 6. Regulate paver machine speed to obtain smooth, continuous surface free of pulls and tears in asphalt-paving mat.
- B. Place paving in consecutive strips not less than 10 feet wide unless infill edge strips of a lesser width are required.
 1. After first strip has been placed and rolled, place succeeding strips and extend rolling to overlap previous strips. Overlap mix placement about 1 to 1-1/2 inches from strip to strip to ensure proper compaction of mix along longitudinal joints.
 2. Complete a section of asphalt base course before placing asphalt surface course.
- C. Promptly correct surface irregularities in paving course behind paver. Use suitable hand tools to remove excess material forming high spots. Fill depressions with hot-mix asphalt to prevent segregation of mix; use suitable hand tools to smooth surface.

3.5 JOINTS

- A. Construct joints to ensure a continuous bond between adjoining paving sections. Construct joints free of depressions, with same texture and smoothness as other sections of hot-mix asphalt course.
 1. Clean contact surfaces and apply tack coat to joints.
 2. Offset longitudinal joints, in successive courses, a minimum of 6 inches.

3. Offset transverse joints, in successive courses, a minimum of 24 inches.
4. Perform work in a manner that allows each course to be completed the day it started.
5. Compact joints as soon as hot-mix asphalt will bear roller weight without excessive displacement.
6. Compact asphalt at joints to a density within 2 percent of specified course density.

3.6 COMPACTION

- A. General: Begin compaction as soon as placed hot-mix paving will bear roller weight without excessive displacement. Compact hot-mix paving with hot, hand tampers or with vibratory-plate compactors in areas inaccessible to rollers.
 1. Complete compaction before mix temperature cools to 185 deg F.
- B. Breakdown Rolling: Complete breakdown or initial rolling immediately after rolling joints and outside edge. Examine surface immediately after breakdown rolling for indicated crown, grade, and smoothness. Correct laydown and rolling operations to comply with requirements.
- C. Intermediate Rolling: Begin intermediate rolling immediately after breakdown rolling while hot-mix asphalt is still hot enough to achieve specified density. Continue rolling until hot-mix asphalt course has been uniformly compacted to the following density:
 1. Average Density: 92 percent of reference maximum theoretical density according to ASTM D 2041/D 2041M, but not less than 90 percent or greater than 96 percent.
- D. Finish Rolling: Finish roll paved surfaces to remove roller marks while hot-mix asphalt is still warm.
- E. Edge Shaping: While surface is being compacted and finished, trim edges of pavement to proper alignment. Bevel edges while asphalt is still hot; compact thoroughly.
- F. Repairs: Remove paved areas that are defective or contaminated with foreign materials and replace with fresh, hot-mix asphalt. Compact by rolling to specified density and surface smoothness.
- G. Protection: After final rolling, do not permit vehicular traffic on pavement until it has cooled and hardened.
- H. Erect barricades to protect paving from traffic until mixture has cooled enough not to become marked.

3.7 INSTALLATION TOLERANCES

- A. Pavement Thickness: Compact each course to produce the thickness indicated within the following tolerances:
 1. Base Course: Plus or minus 1/2 inch.
 2. Surface Course: Plus 1/4 inch, no minus.

- B. Pavement Surface Smoothness: Compact each course to produce a surface smoothness within the following tolerances as determined by using a 10-foot straightedge applied transversely or longitudinally to paved areas:
 - 1. Base Course: 1/4 inch.
 - 2. Surface Course: 1/8 inch.
 - 3. Crowned Surfaces: Test with crowned template centered and at right angle to crown. Maximum allowable variance from template is 1/4 inch.

3.8 FIELD QUALITY CONTROL

- A. Testing Agency: Owner will engage a qualified testing agency to perform tests and inspections.
- B. Thickness: In-place compacted thickness of hot-mix asphalt courses will be determined according to ASTM D 3549.
- C. Surface Smoothness: Finished surface of each hot-mix asphalt course will be tested for compliance with smoothness tolerances.
- D. In-Place Density: Testing agency will take samples of uncompacted paving mixtures and compacted pavement according to ASTM D 979.
 - 1. Reference maximum theoretical density will be determined by averaging results from four samples of hot-mix asphalt-paving mixture delivered daily to site, prepared according to ASTM D 2041/D 2041M, and compacted according to job-mix specifications.
 - 2. In-place density of compacted pavement will be determined by testing core samples according to ASTM D 1188 or ASTM D 2726.
 - a. One core sample will be taken for every 1000 sq. yd. or less of installed pavement, with no fewer than three cores taken.
 - b. Field density of in-place compacted pavement may also be determined by nuclear method according to ASTM D 2950 and correlated with ASTM D 1188 or ASTM D 2726.
- E. Replace and compact hot-mix asphalt where core tests were taken.
- F. Remove and replace or install additional hot-mix asphalt where test results or measurements indicate that it does not comply with specified requirements.

END OF SECTION 321216

SECTION 321313 - CONCRETE PAVING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes Concrete Paving, including the following:
 - 1. Aprons.
 - 2. Curbs.
 - 3. Walks.
- B. Related Requirements:
 - 1. Section 033000 "Cast-in-Place Concrete" for general building applications of concrete.

1.3 DEFINITIONS

- A. Cementitious Materials: Portland cement alone or in combination with one or more of blended hydraulic cement, fly ash, slag cement, and other pozzolans.
- B. W/C Ratio: The ratio by weight of water to cementitious materials.

1.4 ACTION SUBMITTALS

- A. Product Data: For each type of product.
- B. Design Mixtures: For each concrete paving mixture. Include alternate design mixtures when characteristics of materials, Project conditions, weather, test results, or other circumstances warrant adjustments.

1.5 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For qualified ready-mix concrete manufacturer and testing agency.
- B. Material Certificates: For the following, from manufacturer:
 - 1. Cementitious materials.
 - 2. Steel reinforcement and reinforcement accessories.
 - 3. Fiber reinforcement.
 - 4. Admixtures.

5. Curing compounds.
6. Applied finish materials.
7. Bonding agent or epoxy adhesive.
8. Joint fillers.

C. Material Test Reports: For each of the following:

1. Aggregates: Include service-record data indicating absence of deleterious expansion of concrete due to alkali-aggregate reactivity.

D. Field quality-control reports.

1.6 QUALITY ASSURANCE

A. Ready-Mix-Concrete Manufacturer Qualifications: A firm experienced in manufacturing ready-mixed concrete products and that complies with ASTM C 94/C 94M requirements for production facilities and equipment.

1. Manufacturer certified according to NRMCA's "Certification of Ready Mixed Concrete Production Facilities" (Quality Control Manual - Section 3, "Plant Certification Checklist").

B. Testing Agency Qualifications: Qualified according to ASTM C 1077 and ASTM E 329 for testing indicated.

1. Personnel conducting field tests shall be qualified as ACI Concrete Field Testing Technician, Grade 1, according to ACI CP-1 or an equivalent certification program.

1.7 FIELD CONDITIONS

A. Traffic Control: Maintain access for vehicular and pedestrian traffic as required for other construction activities.

B. Cold-Weather Concrete Placement: Protect concrete work from physical damage or reduced strength that could be caused by frost, freezing, or low temperatures. Comply with ACI 306.1 and the following:

1. When air temperature has fallen to or is expected to fall below 40 deg F, uniformly heat water and aggregates before mixing to obtain a concrete mixture temperature of not less than 50 deg F and not more than 80 deg F at point of placement.
2. Do not use frozen materials or materials containing ice or snow.
3. Do not use calcium chloride, salt, or other materials containing antifreeze agents or chemical accelerators unless otherwise specified and approved in design mixtures.

C. Hot-Weather Concrete Placement: Comply with ACI 301 and as follows when hot-weather conditions exist:

1. Cool ingredients before mixing to maintain concrete temperature below 90 deg F at time of placement. Chilled mixing water or chopped ice may be used to control temperature,

provided water equivalent of ice is calculated in total amount of mixing water. Using liquid nitrogen to cool concrete is Contractor's option.

2. Cover steel reinforcement with water-soaked burlap, so steel temperature will not exceed ambient air temperature immediately before embedding in concrete.
3. Fog-spray forms, steel reinforcement, and subgrade just before placing concrete. Keep subgrade moisture uniform without standing water, soft spots, or dry areas.

PART 2 - PRODUCTS

2.1 CONCRETE, GENERAL

- A. ACI Publications: Comply with ACI 301 unless otherwise indicated.

2.2 FORMS

- A. Form Materials: Plywood, metal, metal-framed plywood, or other approved panel-type materials to provide full-depth, continuous, straight, and smooth exposed surfaces.
 1. Use flexible or uniformly curved forms for curves with a radius of 100 feet or less. Do not use notched and bent forms.
- B. Form-Release Agent: Commercially formulated form-release agent that will not bond with, stain, or adversely affect concrete surfaces and that will not impair subsequent treatments of concrete surfaces.

2.3 STEEL REINFORCEMENT

- A. Plain-Steel Welded-Wire Reinforcement: ASTM A 1064, fabricated from steel wire into flat sheets.
- B. Reinforcing Bars: ASTM A 615, Grade 60; deformed.
- C. Joint Dowel Bars: ASTM A 615, Grade 60 plain-steel bars. Cut bars true to length with ends square and free of burrs.
- D. Tie Bars: ASTM A 615, Grade 60; deformed.
- E. Hook Bolts: ASTM A 307, Grade A, internally and externally threaded. Design hook-bolt joint assembly to hold coupling against paving form and in position during concreting operations, and to permit removal without damage to concrete or hook bolt.
- F. Bar Supports: Bolsters, chairs, spacers, and other devices for spacing, supporting, and fastening reinforcing bars, welded-wire reinforcement, and dowels in place. Manufacture bar supports according to CRSI's "Manual of Standard Practice" from steel wire, plastic, or precast concrete of greater compressive strength than concrete specified, and as follows:
 1. Equip wire bar supports with sand plates or horizontal runners where base material will not support chair legs.

2.4 CONCRETE MATERIALS

- A. Cementitious Materials: Use the following cementitious materials, of same type, brand, and source throughout Project:
 - 1. Portland Cement: ASTM C 150, gray, portland cement Type I, Type II or Type III.
 - 2. Fly Ash: ASTM C 618, Class C or Class F.
 - 3. Slag Cement: ASTM C 989, Grade 100 or 120.
 - 4. Blended Hydraulic Cement: ASTM C 595, Type IP, portland-pozzolan cement.
- B. Normal-Weight Aggregates: ASTM C 33, Class 4S, uniformly graded. Provide aggregates from a single source.
 - 1. Maximum Coarse-Aggregate Size: 1 inch nominal.
 - 2. Fine Aggregate: Free of materials with deleterious reactivity to alkali in cement.
- C. Air-Entraining Admixture: ASTM C 260.
- D. Chemical Admixtures: Admixtures certified by manufacturer to be compatible with other admixtures and to contain not more than 0.1 percent water-soluble chloride ions by mass of cementitious material.
 - 1. Water-Reducing Admixture: ASTM C 494, Type A.
 - 2. Retarding Admixture: ASTM C 494, Type B.
 - 3. Water-Reducing and Retarding Admixture: ASTM C 494, Type D.
 - 4. High-Range, Water-Reducing Admixture: ASTM C 494, Type F.
 - 5. High-Range, Water-Reducing and Retarding Admixture: ASTM C 494, Type G.
 - 6. Plasticizing and Retarding Admixture: ASTM C 1017, Type II.
- E. Water: Potable and complying with ASTM C 94.

2.5 CURING MATERIALS

- A. Absorptive Cover: AASHTO M 182, Class 2, burlap cloth made from jute or kenaf, weighing approximately 9 oz./sq. yd. dry or cotton mats.
- B. Moisture-Retaining Cover: ASTM C 171, polyethylene film or white burlap-polyethylene sheet.
- C. Water: Potable.
- D. Evaporation Retarder: Waterborne, monomolecular, film forming, manufactured for application to fresh concrete.
- E. White, Waterborne, Membrane-Forming Curing Compound: ASTM C 309, Type 2, Class B, dissipating.

2.6 RELATED MATERIALS

- A. Joint Fillers: ASTM D 1751, asphalt-saturated cellulosic fiber or ASTM D 1752, cork or self-expanding cork in preformed strips.

2.7 CONCRETE MIXTURES

- A. Prepare design mixtures, proportioned according to ACI 301, for each type and strength of normal-weight concrete, and as determined by either laboratory trial mixtures or field experience.
 - 1. Use a qualified independent testing agency for preparing and reporting proposed concrete design mixtures for the trial batch method.
- B. Cementitious Materials: Limit percentage, by weight, of cementitious materials other than portland cement in concrete as follows:
 - 1. Fly Ash or Pozzolan: 25 percent.
 - 2. Slag Cement: 15 percent.
 - 3. Combined Fly Ash or Pozzolan, and Slag Cement: 25 percent, with fly ash or pozzolan not exceeding 20 percent.
- C. Add air-entraining admixture at manufacturer's prescribed rate to result in normal-weight concrete at point of placement having an air content as follows:
 - 1. Air Content: 5 percent plus or minus 1 percent for 1-inch nominal maximum aggregate size.
 - 2. Air Content: 5 percent plus or minus 1 percent for 3/4-inch nominal maximum aggregate size.
- D. Limit water-soluble, chloride-ion content in hardened concrete to 0.15 percent by weight of cement.
- E. Chemical Admixtures: Use admixtures according to manufacturer's written instructions.
 - 1. Use plasticizing and retarding admixture in concrete as required for placement and workability.
 - 2. Use water-reducing and retarding admixture when required by high temperatures, low humidity, or other adverse placement conditions.
- F. Concrete Mixtures: Normal-weight concrete.
 - 1. Compressive Strength (28 Days): 4,000 psi.
 - 2. Maximum W/C Ratio at Point of Placement: 0.45.
 - 3. Slump Limit: 4 inches, plus or minus 1 inch.

2.8 CONCRETE MIXING

- A. Ready-Mixed Concrete: Measure, batch, and mix concrete materials and concrete according to ASTM C 94 and ASTM C 1116. Furnish batch certificates for each batch discharged and used in the Work.
 - 1. When air temperature is between 85 and 90 deg F, reduce mixing and delivery time from 1-1/2 hours to 75 minutes; when air temperature is above 90 deg F, reduce mixing and delivery time to 60 minutes.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine exposed subgrades and subbase surfaces for compliance with requirements for dimensional, grading, and elevation tolerances.
- B. Proof-roll prepared subbase surface to identify soft pockets and areas of excess yielding.
 - 1. Completely proof-roll subbase in one direction and repeat in perpendicular direction. Limit vehicle speed to 3 mph.
 - 2. Proof-roll with a pneumatic-tired and loaded, 10-wheel, tandem-axle dump truck weighing not less than 15 tons.
 - 3. Correct subbase with soft spots and areas of pumping or rutting exceeding depth of 1/2 inch according to requirements in Section 312000 "Earth Moving."
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Remove loose material from compacted subbase surface immediately before placing concrete.

3.3 EDGE FORMS AND SCREED CONSTRUCTION

- A. Set, brace, and secure edge forms, bulkheads, and intermediate screed guides to required lines, grades, and elevations. Install forms to allow continuous progress of work and so forms can remain in place at least 24 hours after concrete placement.
- B. Clean forms after each use and coat with form-release agent to ensure separation from concrete without damage.

3.4 STEEL REINFORCEMENT INSTALLATION

- A. General: Comply with CRSI's "Manual of Standard Practice" for fabricating, placing, and supporting reinforcement.
- B. Clean reinforcement of loose rust and mill scale, earth, ice, or other bond-reducing materials.
- C. Arrange, space, and securely tie bars and bar supports to hold reinforcement in position during concrete placement. Maintain minimum cover to reinforcement.
- D. Install welded-wire reinforcement in lengths as long as practicable. Lap adjoining pieces at least one full mesh, and lace splices with wire. Offset laps of adjoining widths to prevent continuous laps in either direction.
- E. Install fabricated bar mats in lengths as long as practicable. Handle units to keep them flat and free of distortions. Straighten bends, kinks, and other irregularities, or replace units as required before placement. Set mats for a minimum 2-inch overlap of adjacent mats.

3.5 JOINTS

- A. General: Form construction, isolation, and contraction joints and tool edges true to line, with faces perpendicular to surface plane of concrete. Construct transverse joints at right angles to centerline unless otherwise indicated.
1. When joining existing paving, place transverse joints to align with previously placed joints unless otherwise indicated.
- B. Construction Joints: Set construction joints at side and end terminations of paving and at locations where paving operations are stopped for more than one-half hour unless paving terminates at isolation joints.
1. Continue steel reinforcement across construction joints unless otherwise indicated. Do not continue reinforcement through sides of paving strips unless otherwise indicated.
 2. Provide tie bars at sides of paving strips where indicated.
 3. Butt Joints: Use bonding agent at joint locations where fresh concrete is placed against hardened or partially hardened concrete surfaces.
 4. Keyed Joints: Provide preformed keyway-section forms or bulkhead forms with keys unless otherwise indicated. Embed keys at least 1-1/2 inches into concrete.
 5. Doweled Joints: Install dowel bars and support assemblies at joints where indicated. Lubricate or coat with asphalt one-half of dowel length to prevent concrete bonding to one side of joint.
- C. Isolation Joints: Form isolation joints of preformed joint-filler strips abutting concrete curbs, catch basins, manholes, inlets, structures, other fixed objects, and where indicated.
1. Locate expansion joints at intervals of 50 feet unless otherwise indicated.
 2. Extend joint fillers full width and depth of joint.
 3. Terminate joint filler not less than 1/2 inch or more than 1 inch below finished surface if joint sealant is indicated.
 4. Place top of joint filler flush with finished concrete surface if joint sealant is not indicated.
 5. Furnish joint fillers in one-piece lengths. Where more than one length is required, lace or clip joint-filler sections together.
 6. During concrete placement, protect top edge of joint filler with metal, plastic, or other temporary preformed cap. Remove protective cap after concrete has been placed on both sides of joint.
- D. Contraction Joints: Form weakened-plane contraction joints, sectioning concrete into areas as indicated. Construct contraction joints for a depth equal to at least one-fourth of the concrete thickness, as follows:
1. Grooved Joints: Form contraction joints after initial floating by grooving and finishing each edge of joint with grooving tool to a 1/4-inch radius. Repeat grooving of contraction joints after applying surface finishes. Eliminate grooving-tool marks on concrete surfaces.
 2. Sawed Joints: Form contraction joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/8-inch wide joints into concrete when cutting

action will not tear, abrade, or otherwise damage surface and before developing random contraction cracks.

- E. Edging: After initial floating, tool edges of paving, gutters, curbs, and joints in concrete with an edging tool to a 1/4-inch radius. Repeat tooling of edges after applying surface finishes.

3.6 CONCRETE PLACEMENT

- A. Before placing concrete, inspect and complete formwork installation, steel reinforcement, and items to be embedded or cast-in.
- B. Remove snow, ice, or frost from subbase surface and steel reinforcement before placing concrete. Do not place concrete on frozen surfaces.
- C. Moisten subbase to provide a uniform dampened condition at time concrete is placed. Do not place concrete around manholes or other structures until they are at required finish elevation and alignment.
- D. Comply with ACI 301 requirements for measuring, mixing, transporting, and placing concrete.
- E. Do not add water to concrete during delivery or at Project site. Do not add water to fresh concrete after testing.
- F. Deposit and spread concrete in a continuous operation between transverse joints. Do not push or drag concrete into place or use vibrators to move concrete into place.
- G. Consolidate concrete according to ACI 301 by mechanical vibrating equipment supplemented by hand spading, rodding, or tamping.
 - 1. Consolidate concrete along face of forms and adjacent to transverse joints with an internal vibrator. Keep vibrator away from joint assemblies, reinforcement, or side forms. Use only square-faced shovels for hand spreading and consolidation. Consolidate with care to prevent dislocating reinforcement and joint devices.
- H. Screed paving surface with a straightedge and strike off.
- I. Commence initial floating using bull floats or darbies to impart an open-textured and uniform surface plane before excess moisture or bleedwater appears on the surface. Do not further disturb concrete surfaces before beginning finishing operations or spreading surface treatments.

3.7 FLOAT FINISHING

- A. General: Do not add water to concrete surfaces during finishing operations.
- B. Float Finish: Begin the second floating operation when bleedwater sheen has disappeared and concrete surface has stiffened sufficiently to permit operations. Float surface with power-driven floats or by hand floating if area is small or inaccessible to power units. Finish surfaces to true planes. Cut down high spots and fill low spots. Rfloat surface immediately to uniform granular texture.

1. Burlap Finish: Drag a seamless strip of damp burlap across float-finished concrete, perpendicular to line of traffic, to provide a uniform, gritty texture.
2. Medium-to-Fine-Textured Broom Finish: Draw a soft-bristle broom across float-finished concrete surface, perpendicular to line of traffic, to provide a uniform, fine-line texture.
3. Medium-to-Coarse-Textured Broom Finish: Provide a coarse finish by striating float-finished concrete surface 1/16 to 1/8 inch deep with a stiff-bristled broom, perpendicular to line of traffic.

3.8 CONCRETE PROTECTION AND CURING

- A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures.
- B. Comply with ACI 306.1 for cold-weather protection.
- C. Evaporation Retarder: Apply evaporation retarder to concrete surfaces if hot, dry, or windy conditions cause moisture loss approaching 0.2 lb/sq. ft. x h before and during finishing operations. Apply according to manufacturer's written instructions after placing, screeding, and bull floating or darbying concrete but before float finishing.
- D. Begin curing after finishing concrete but not before free water has disappeared from concrete surface.
- E. Curing Methods: Cure concrete by moisture curing, moisture-retaining-cover curing, curing compound or a combination of these as follows:
 1. Moisture Curing: Keep surfaces continuously moist for not less than seven days with the following materials:
 - a. Water.
 - b. Continuous water-fog spray.
 - c. Absorptive cover, water saturated and kept continuously wet. Cover concrete surfaces and edges with 12-inch lap over adjacent absorptive covers.
 2. Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover, placed in widest practicable width, with sides and ends lapped at least 12 inches, and sealed by waterproof tape or adhesive. Immediately repair any holes or tears occurring during installation or curing period, using cover material and waterproof tape.
 3. Curing Compound: Apply uniformly in continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas subjected to heavy rainfall within three hours after initial application. Maintain continuity of coating, and repair damage during curing period.

3.9 PAVING TOLERANCES

- A. Comply with tolerances in ACI 117 and as follows:
 1. Elevation: 1/2 inch.
 2. Thickness: Plus 3/8 inch, minus 1/4 inch.

3. Surface: Gap below 10-feet- long; unlevelled straightedge not to exceed 1/4 inch.
4. Joint Spacing: 3 inches (75 mm).
5. Contraction Joint Depth: Plus 1/4 inch (6 mm), no minus.
6. Joint Width: Plus 1/8 inch, no minus.

3.10 FIELD QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing agency to perform tests and inspections.
- B. Testing Services: Testing and inspecting of composite samples of fresh concrete obtained according to ASTM C 172 shall be performed according to the following requirements:
 1. Testing Frequency: Obtain at least one composite sample for each 50 cu. yd. or fraction thereof of each concrete mixture placed each day.
 - a. When frequency of testing will provide fewer than five compressive-strength tests for each concrete mixture, testing shall be conducted from at least five randomly selected batches or from each batch if fewer than five are used.
 2. Slump: ASTM C 143; one test at point of placement for each composite sample, but not less than one test for each day's pour of each concrete mixture. Perform additional tests when concrete consistency appears to change.
 3. Air Content: ASTM C 231, pressure method; one test for each composite sample, but not less than one test for each day's pour of each concrete mixture.
 4. Concrete Temperature: ASTM C 1064; one test hourly when air temperature is 40 deg F and below and when it is 80 deg F and above, and one test for each composite sample.
 5. Compression Test Specimens: ASTM C 31; cast and laboratory cure one set of five standard cylinder specimens for each composite sample.
 6. Compressive-Strength Tests: ASTM C 39; test one specimen at seven days and two specimens at 28 days.
 - a. A compressive-strength test shall be the average compressive strength from two specimens obtained from same composite sample and tested at 28 days.
- C. Strength of each concrete mixture will be satisfactory if the average of the two 28 day specimens exceeds the specified strength and no compressive-strength test value falls below specified compressive strength by more than 500 psi.
 1. If the average of two specimens is below a fourth cylinder from that set shall be broken and averaged with the previous 2.
 2. If the average of the three 28 day breaks does not meet strength requirements the final cylinder from that set shall be tested. The average of the three highest compressive strength reports (lowest value discarded) meet specified strength the mixture will be considered adequate.
- D. Test results shall be reported in writing to Engineer, concrete manufacturer, and Contractor within 48 hours of testing. Reports of compressive-strength tests shall contain Project identification name and number, date of concrete placement, name of concrete testing and inspecting agency, location of concrete batch in Work, design compressive strength at 28 days, concrete mixture proportions and materials, compressive breaking strength, and type of break for both 7- and 28-day tests.

- E. Nondestructive Testing: Impact hammer, sonoscope, or other nondestructive device may be permitted by Architect but will not be used as sole basis for approval or rejection of concrete.
- F. Additional Tests: Testing and inspecting agency shall make additional tests of concrete when test results indicate that slump, air entrainment, compressive strengths, or other requirements have not been met, as directed by Engineer.
- G. Concrete paving will be considered defective if it does not pass tests and inspections.
- H. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.
- I. Prepare test and inspection reports.

3.11 REPAIR AND PROTECTION

- A. Remove and replace concrete paving that is broken, damaged, or defective or that does not comply with requirements in this Section. Remove work in complete sections from joint to joint unless otherwise approved by Architect.
- B. Drill test cores, where directed by Architect, when necessary to determine magnitude of cracks or defective areas. Fill drilled core holes in satisfactory paving areas with portland cement concrete bonded to paving with epoxy adhesive.
- C. Protect concrete paving from damage. Exclude traffic from paving for at least 14 days after placement. When construction traffic is permitted, maintain paving as clean as possible by removing surface stains and spillage of materials as they occur.
- D. Maintain concrete paving free of stains, discoloration, dirt, and other foreign material. Sweep paving not more than two days before date scheduled for Substantial Completion inspections.

END OF SECTION 321313

SECTION 321713 - PARKING BUMPERS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes concrete or resilient wheel stops.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.

PART 2 - PRODUCTS

2.1 PARKING BUMPERS

- A. Concrete Wheel Stops: Precast, steel-reinforced, air-entrained concrete, 4000-psi minimum compressive strength, 5 inches high by 9 inches wide by 72 inches long. Provide chamfered corners, transverse drainage slots on underside, and a minimum of two factory-formed or -drilled vertical holes through wheel stop for anchoring to substrate.
 - 1. Surface Appearance: Free of pockets, sand streaks, honeycombs, and other obvious defects. Corners shall be uniform, straight, and sharp.
 - 2. Surface Sealer: Manufacturer's standard salt-resistant, clear sealer, applied at precasting location.
 - 3. Mounting Hardware: Galvanized-steel spike or dowel, 1/2-inch diameter, 10-inch minimum length.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verify that pavement is in suitable condition to begin installation according to manufacturer's written instructions.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Install wheel stops according to manufacturer's written instructions unless otherwise indicated.
- B. Install wheel stops in bed of adhesive before anchoring.
- C. Securely anchor wheel stops to pavement with hardware in each preformed vertical hole in wheel stop as recommended in writing by manufacturer. Recess head of hardware beneath top of wheel stop.

END OF SECTION 321713

SECTION 321723 - PAVEMENT MARKINGS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes painted markings applied to asphalt and concrete pavement.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 - 1. Include technical data and tested physical and performance properties.
- B. Shop Drawings: For pavement markings.
 - 1. Indicate pavement markings, colors, lane separations, defined parking spaces, and dimensions to adjacent work.
 - 2. Indicate, with international symbol of accessibility, spaces allocated for people with disabilities.

1.4 QUALITY ASSURANCE

- A. Regulatory Requirements: Comply with materials, workmanship, and other applicable requirements of n Michigan Department of Transportation 2012 Standard Specifications for Construction for pavement-marking work.

1.5 FIELD CONDITIONS

- A. Environmental Limitations: Proceed with pavement marking only on clean, dry surfaces and at a minimum ambient or surface temperature of 55 deg F for water-based materials, and not exceeding 95 deg F.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Accessibility Standard: Comply with applicable provisions in the USDOJ's "2010 ADA Standards for Accessible Design"

2.2 PAVEMENT-MARKING PAINT

- A. Pavement-Marking Paint: Latex, waterborne emulsion, lead and chromate free, ready mixed, complying with FS TT-P-1952, Type II, with drying time of less than 45 minutes.
 - 1. Color: As indicated.
- B. Glass Beads: AASHTO M 247, Type 1 made of 100 percent recycled glass.
 - 1. Roundness: Minimum 75 percent true spheres by weight.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verify that pavement is dry and in suitable condition to begin pavement marking according to manufacturer's written instructions.
- B. Proceed with pavement marking only after unsatisfactory conditions have been corrected.

3.2 PAVEMENT MARKING

- A. Do not apply pavement-marking paint until layout, colors, and placement have been verified with Engineer. Marking-paint manufacturers caution that paint will bleed or tear surface of new asphalt unless asphalt is aged before painting. This aging period may vary from 30 to 90 days. If pavement marking must proceed immediately, consider revising text to a phased application of a thin first coat followed by a thicker second coat once asphalt has aged. Verify that two-coat application is recommended by marking-paint manufacturer.
- B. Initial application may be applied immediately, second application between 14 to 30 days after initial application.
- C. Apply when the surface temperature and ambient air temperature are both 50 deg. F or above.
- D. Sweep and clean surface to eliminate loose material and dust.
- E. Apply paint with mechanical equipment to produce pavement markings, of dimensions indicated, with uniform, straight edges. Apply at manufacturer's recommended rates to provide a minimum wet film thickness of 15 mils.

1. Apply graphic symbols and lettering with paint-resistant, die-cut stencils, firmly secured to pavement. Mask an extended area beyond edges of each stencil to prevent paint application beyond stencil. Apply paint so that it cannot run beneath stencil.
 2. Broadcast glass beads uniformly into wet markings at a rate of 6 lb/gal..
- F. If weather limitations prevent placement of waterborne paint, the use of regular dry paint may be approved by the Engineer.

3.3 PROTECTING AND CLEANING

- A. Protect pavement markings from damage and wear during remainder of construction period.
- B. Clean spillage and soiling from adjacent construction using cleaning agents and procedures recommended by manufacturer of affected construction.

END OF SECTION 321723

SECTION 329115 - SOIL PREPARATION (PERFORMANCE SPECIFICATION)

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes planting soils and layered soil assemblies specified according to performance requirements of the mixes.
- B. Related Requirements:
 - 1. Section 311000 "Site Clearing" for topsoil stripping and stockpiling.
 - 2. Section 329200 "Turf and Grasses" for placing planting soil for turf and grasses.
 - 3. Section 329300 "Plants" for placing planting soil for plantings.

1.3 DEFINITIONS

- A. AAPFCO: Association of American Plant Food Control Officials.
- B. Backfill: The earth used to replace or the act of replacing earth in an excavation. This can be amended or unamended soil as indicated.
- C. CEC: Cation exchange capacity.
- D. Compost: The product resulting from the controlled biological decomposition of organic material that has been sanitized through the generation of heat and stabilized to the point that it is beneficial to plant growth.
- E. Duff Layer: A surface layer of soil, typical of forested areas, that is composed of mostly decayed leaves, twigs, and detritus.
- F. Imported Soil: Soil that is transported to Project site for use.
- G. Layered Soil Assembly: A designed series of planting soils, layered on each other, that together produce an environment for plant growth.
- H. Manufactured Soil: Soil produced by blending soils, sand, stabilized organic soil amendments, and other materials to produce planting soil.
- I. NAPT: North American Proficiency Testing Program. An SSSA program to assist soil-, plant-, and water-testing laboratories through inter-laboratory sample exchanges and statistical evaluation of analytical data.

- J. Organic Matter: The total of organic materials in soil exclusive of undecayed plant and animal tissues, their partial decomposition products, and the soil biomass; also called "humus" or "soil organic matter."
- K. Planting Soil: Existing, on-site soil; imported soil; or manufactured soil that has been modified as specified with soil amendments and perhaps fertilizers to produce a soil mixture best for plant growth.
- L. RCRA Metals: Hazardous metals identified by the EPA under the Resource Conservation and Recovery Act.
- M. SSSA: Soil Science Society of America.
- N. Subgrade: Surface or elevation of subsoil remaining after excavation is complete, or the top surface of a fill or backfill before planting soil is placed.
- O. Subsoil: Soil beneath the level of subgrade; soil beneath the topsoil layers of a naturally occurring soil profile, typified by less than 1 percent organic matter and few soil organisms.
- P. Surface Soil: Soil that is present at the top layer of the existing soil profile. In undisturbed areas, surface soil is typically called "topsoil"; but in disturbed areas such as urban environments, the surface soil can be subsoil.
- Q. USCC: U.S. Composting Council.

1.4 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 1. Include recommendations for application and use.
 2. Include test data substantiating that products comply with requirements.
 3. Material Certificates: For each type of fertilizer before delivery to the site, according to the following:
 - a. Manufacturer's qualified testing agency's certified analysis of standard products.
 - b. Analysis of fertilizers, by a qualified testing agency, made according to AAPFCO methods for testing and labeling and according to AAPFCO's SUIP #25.
 - c. Analysis of nonstandard materials, by a qualified testing agency, made according to SSSA methods, where applicable.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Packaged Materials: Deliver packaged materials in original, unopened containers showing weight, certified analysis, name and address of manufacturer, and compliance with state and Federal laws if applicable.

PART 2 - PRODUCTS

2.1 PLANTING SOILS SPECIFIED ACCORDING TO PERFORMANCE REQUIREMENTS

- A. Planting-Soil Type Native Topsoil: Existing, on-site surface soil, with the duff layer, if any, retained; and stockpiled on-site; modified to produce viable planting soil. Using preconstruction soil analyses and materials specified in other articles of this Section, amend existing, on-site surface soil to become planting soil complying with the following requirements:
1. Percentage of Organic Matter: Minimum 3 percent by volume.
 2. Soil Reaction: pH of 6 to 7.
- B. Planting-Soil Type Imported Topsoil: Imported, naturally formed soil from off-site sources and consisting of sandy loam soil according to USDA textures; and modified to produce viable planting soil. Amend imported soil with materials specified in other articles of this Section to become planting soil complying with the following requirements:
1. Sources: Take imported, unamended soil from sources that are naturally well-drained sites where topsoil occurs at least 4 inches deep, not from bogs, or marshes; and that do not contain undesirable organisms; disease-causing plant pathogens; or obnoxious weeds and invasive plants including, but not limited to, quackgrass, Johnsongrass, poison ivy, nutsedge, nimblewill, Canada thistle, bindweed, bentgrass, wild garlic, ground ivy, perennial sorrel, and bromegrass.
 2. Additional Properties of Imported Soil before Amending: Minimum of 4 percent organic-matter content, friable, and with sufficient structure to give good tilth and aeration. Clean soil to be of the following:
 - a. Unacceptable Materials: Concrete slurry, concrete layers or chunks, cement, plaster, building debris, oils, gasoline, diesel fuel, paint thinner, turpentine, tar, roofing compound, acid, and other extraneous materials that are harmful to plant growth.
 - b. Unsuitable Materials: Stones, roots, plants, sod, clay lumps, and pockets of coarse sand that exceed a combined maximum of 2 percent by dry weight of the imported soil.
 - c. Large Materials: Stones, clods, roots, clay lumps, and pockets of coarse sand exceeding 1-1/2 inches in any dimension.
 3. Percentage of Organic Matter: Minimum 3 percent by volume.
 4. Soil Reaction: pH of 6 to 7.

2.2 INORGANIC SOIL AMENDMENTS

- A. Lime: ASTM C 602, agricultural liming material containing a minimum of 80 percent calcium carbonate equivalent and as follows:
1. Class: T, with a minimum of 99 percent passing through a No. 8 sieve and a minimum of 75 percent passing through a No. 60 sieve.
 2. Form: Provide lime in form of ground dolomitic limestone.

- B. Sulfur: Granular, biodegradable, and containing a minimum of 90 percent elemental sulfur, with a minimum of 99 percent passing through a No. 6 sieve and a maximum of 10 percent passing through a No. 40 sieve.
- C. Iron Sulfate: Granulated ferrous sulfate containing a minimum of 20 percent iron and 10 percent sulfur.
- D. Agricultural Gypsum: Minimum 90 percent calcium sulfate, finely ground with 90 percent passing through a No. 50 sieve.
- E. Sand: Clean, washed, natural or manufactured, free of toxic materials, and according to ASTM C 33/C 33M.

2.3 ORGANIC SOIL AMENDMENTS

- A. Compost: Well-composted, stable, and weed-free organic matter produced by composting feedstock, and bearing USCC's "Seal of Testing Assurance," and as follows:
 - 1. Feedstock: May include sewage sludge or animal waste.
 - 2. Reaction: pH of 5.5 to 8
 - 3. USCC soluble-salt concentration requirement is less than 10 dS/m.
 - 4. Soluble-Salt Concentration: Less than 4 dS/m.
 - 5. Moisture Content: 35 to 55 percent by weight.
 - 6. Organic-Matter Content: 30 to 40 percent of dry weight.
 - 7. Particle Size: Minimum of 98 percent passing through a 1-inch sieve.
- B. Sphagnum Peat: Partially decomposed sphagnum peat moss, finely divided or of granular texture with 100 percent passing through a 1/2-inch sieve, a pH of 3.4 to 4.8, and a soluble-salt content measured by electrical conductivity of maximum 5 dS/m.
- C. Muck Peat: Partially decomposed moss peat, native peat, or reed-sedge peat, finely divided or of granular texture with 100 percent passing through a 1/2-inch sieve, a pH of 6 to 7.5, a soluble-salt content measured by electrical conductivity of maximum 5 dS/m, having a water-absorbing capacity of 1100 to 2000 percent, and containing no sand.
- D. Wood Derivatives: Shredded and composted, nitrogen-treated sawdust, ground bark, or wood waste; of uniform texture and free of chips, stones, sticks, soil, or toxic materials.
- E. Manure: Well-rotted, unleached, stable or cattle manure containing not more than 25 percent by volume of straw, sawdust, or other bedding materials; free of toxic substances, stones, sticks, soil, weed seed, debris, and material harmful to plant growth.

2.4 FERTILIZERS

- A. Commercial Fertilizer: Commercial-grade complete fertilizer of neutral character, consisting of fast- and slow-release nitrogen, 50 percent derived from natural organic sources of urea formaldehyde, phosphorous, and potassium in the following composition:

1. Composition: 1 lb/1000 sq. ft. of actual nitrogen, 4 percent phosphorous, and 2 percent potassium, by weight.
- B. Slow-Release Fertilizer: Granular or pelleted fertilizer consisting of 50 percent water-insoluble nitrogen, phosphorus, and potassium in the following composition:
 1. Composition: 20 percent nitrogen, 10 percent phosphorous, and 10 percent potassium, by weight.

PART 3 - EXECUTION

3.1 GENERAL

- A. Place planting soil and fertilizers according to requirements in other Specification Sections.
- B. Verify that no foreign or deleterious material or liquid such as paint, paint washout, concrete slurry, concrete layers or chunks, cement, plaster, oils, gasoline, diesel fuel, paint thinner, turpentine, tar, roofing compound, or acid has been deposited in planting soil.
- C. Proceed with placement only after unsatisfactory conditions have been corrected.

3.2 PREPARATION OF UNAMENDED, ON-SITE SOIL BEFORE AMENDING

- A. Excavation: Excavate soil from designated area(s) to a depth as required and stockpile until amended.
- B. Unacceptable Materials: Clean soil of concrete slurry, concrete layers or chunks, cement, plaster, building debris, oils, gasoline, diesel fuel, paint thinner, turpentine, tar, roofing compound, acid, and other extraneous materials that are harmful to plant growth.
- C. Unsuitable Materials: Clean soil to contain a combined maximum of 8 percent by dry weight of stones, roots, plants, sod, clay lumps, and pockets of coarse sand.
- D. Screening: Pass unamended soil through a 1-inch sieve to remove large materials.

3.3 PLACING AND MIXING PLANTING SOIL OVER EXPOSED SUBGRADE

- A. General: Apply and mix unamended soil with amendments on-site to produce required planting soil. Do not apply materials or till if existing soil or subgrade is frozen, muddy, or excessively wet.
- B. Subgrade Preparation: Till subgrade to a minimum depth of 4 inches. Remove stones larger than 1-1/2 inches in any dimension and sticks, roots, rubbish, and other extraneous matter and legally dispose of them off Owner's property.
 1. Apply, add soil amendments, and mix approximately half the thickness of unamended soil over prepared, loosened subgrade according to "Mixing" Paragraph below. Mix thoroughly into top 2 inches of subgrade. Spread remainder of planting soil.

- C. **Mixing:** Spread unamended soil to total depth of 4 inches, but not less than required to meet finish grades after mixing with amendments and natural settlement. Do not spread if soil or subgrade is frozen, muddy, or excessively wet.
 - 1. **Amendments:** Apply soil amendments, and fertilizer, if required, evenly on surface, and thoroughly blend them with unamended soil to produce planting soil.
 - a. Mix lime with dry soil before mixing fertilizer.
 - b. Mix fertilizer with planting soil no more than seven days before planting.
 - 2. **Lifts:** Apply and mix unamended soil and amendments in lifts not exceeding 4 inches in loose depth for material compacted by hand-operated tampers.
- D. **Compaction:** Compact each blended lift of planting soil to 75 to 82 percent of maximum Standard Proctor density according to ASTM D 698.
- E. **Finish Grading:** Grade planting soil to a smooth, uniform surface plane with loose, uniformly fine texture. Roll and rake, remove ridges, and fill depressions to meet finish grades.

3.4 PLACING MANUFACTURED PLANTING SOIL OVER EXPOSED SUBGRADE

- A. **General:** Apply manufactured soil on-site in its final, blended condition. Do not apply materials or till if existing soil or subgrade is frozen, muddy, or excessively wet.
- B. **Subgrade Preparation:** Till subgrade to a minimum depth of 4 inches. Remove stones larger than 1-1/2 inches in any dimension and sticks, roots, rubbish, and other extraneous matter and legally dispose of them off Owner's property.
 - 1. Apply approximately half the thickness of planting soil over prepared, loosened subgrade. Mix thoroughly into top 2 inches of subgrade. Spread remainder of planting soil.
- C. **Application:** Spread planting soil to total depth of 4 inches, but not less than required to meet finish grades after natural settlement. Do not spread if soil or subgrade is frozen, muddy, or excessively wet.
 - 1. **Lifts:** Apply planting soil in lifts not exceeding 4 inches in loose depth for material compacted by hand-operated tampers.
- D. **Compaction:** Compact each lift of planting soil to 75 to 82 percent of maximum Standard Proctor density according to ASTM D 698.
- E. **Finish Grading:** Grade planting soil to a smooth, uniform surface plane with loose, uniformly fine texture. Roll and rake, remove ridges, and fill depressions to meet finish grades.

3.5 PROTECTION

- A. **Protection Zone:** Identify protection zones according to Section 015639 "Temporary Tree and Plant Protection."

- B. Protect areas of in-place soil from additional compaction, disturbance, and contamination. Prohibit the following practices within these areas except as required to perform planting operations:
 - 1. Storage of construction materials, debris, or excavated material.
 - 2. Parking vehicles or equipment.
 - 3. Vehicle traffic.
 - 4. Foot traffic.
 - 5. Erection of sheds or structures.
 - 6. Impoundment of water.
 - 7. Excavation or other digging unless otherwise indicated.

- C. If planting soil or subgrade is over compacted, disturbed, or contaminated by foreign or deleterious materials or liquids, remove the planting soil and contamination; restore the subgrade as directed by Architect and replace contaminated planting soil with new planting soil.

3.6 CLEANING

- A. Protect areas adjacent to planting-soil preparation and placement areas from contamination. Keep adjacent paving and construction clean and work area in an orderly condition.

- B. Remove surplus soil and waste material including excess subsoil, unsuitable materials, trash, and debris and legally dispose of them off Owner's property unless otherwise indicated.
 - 1. Dispose of excess subsoil and unsuitable materials on-site where directed by Owner.

END OF SECTION 329115

SECTION 329200 - TURF AND GRASSES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:

- 1. Seeding.
- 2. Hydroseeding.
- 3. Erosion-control material(s).

- B. Related Requirements:

- 1. Section 329300 "Plants" for trees, shrubs, ground covers, and other plants as well as border edgings and mow strips.

1.3 DEFINITIONS

- A. Finish Grade: Elevation of finished surface of planting soil.
- B. Pesticide: A substance or mixture intended for preventing, destroying, repelling, or mitigating a pest. Pesticides include insecticides, miticides, herbicides, fungicides, rodenticides, and molluscicides. They also include substances or mixtures intended for use as a plant regulator, defoliant, or desiccant.
- C. Pests: Living organisms that occur where they are not desired or that cause damage to plants, animals, or people. Pests include insects, mites, grubs, mollusks (snails and slugs), rodents (gophers, moles, and mice), unwanted plants (weeds), fungi, bacteria, and viruses.
- D. Planting Soil: Existing, on-site soil; imported soil; or manufactured soil that has been modified with soil amendments and perhaps fertilizers to produce a soil mixture best for plant growth. See Section 329115 "Soil Preparation (Performance Specification)" and drawing designations for planting soils.
- E. Subgrade: The surface or elevation of subsoil remaining after excavation is complete, or the top surface of a fill or backfill before planting soil is placed.

1.4 INFORMATIONAL SUBMITTALS

- A. Certification of Grass Seed: From seed vendor for each grass-seed monostand or mixture, stating the botanical and common name, percentage by weight of each species and variety, and percentage of purity, germination, and weed seed. Include the year of production and date of packaging.
- B. Product Certificates: For fertilizers, from manufacturer.
- C. Pesticides and Herbicides: Product label and manufacturer's application instructions specific to Project.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Seed and Other Packaged Materials: Deliver packaged materials in original, unopened containers showing weight, certified analysis, name and address of manufacturer, and indication of compliance with state and Federal laws, as applicable.
- B. Bulk Materials:
 - 1. Do not dump or store bulk materials near structures, utilities, walkways and pavements, or on existing turf areas or plants.
 - 2. Provide erosion-control measures to prevent erosion or displacement of bulk materials; discharge of soil-bearing water runoff; and airborne dust reaching adjacent properties, water conveyance systems, or walkways.
 - 3. Accompany each delivery of bulk materials with appropriate certificates.

1.6 FIELD CONDITIONS

- A. Planting Restrictions: Plant during one of the following periods. Coordinate planting periods with initial maintenance periods to provide required maintenance from date of planting completion
 - 1. Spring Planting: May 1 to June 15.
 - 2. Fall Planting: September 1 to October 1.
 - 3. Dormant Seeding: After November 1 as long as the ground is not frozen.
- B. Weather Limitations: Proceed with planting only when existing and forecasted weather conditions permit planting to be performed when beneficial and optimum results may be obtained. Apply products during favorable weather conditions according to manufacturer's written instructions.

PART 2 - PRODUCTS

2.1 SEED

- A. Grass Seed: Fresh, clean, dry, new-crop seed complying with AOSA's "Rules for Testing Seeds" for purity and germination tolerances.

B. Seed Species:

1. Quality: Seed of grass species as listed below for solar exposure, with not less than 85 percent germination, not less than 95 percent pure seed, and not more than 0.5 percent weed seed:
2. Sun and Partial Shade: Proportioned by weight as follows:
 - a. 20 percent Kentucky bluegrass (95/85).
 - b. 20 percent creeping red fescue.
 - c. 40 percent perennial ryegrass.
 - d. 10 percent redtop.
 - e. 10 percent Kenblue Kentucky bluegrass.
3. Shade: Proportioned by weight as follows:
 - a. 35 percent creeping red fescue.
 - b. 35 percent compass chewings fescue.
 - c. 20 percent turf type perennial rye.
 - d. 10 percent rough bluegrass.

2.2 FERTILIZERS

- A. Commercial Fertilizer: Commercial-grade complete fertilizer of neutral character, consisting of fast- and slow-release nitrogen, 50 percent derived from natural organic sources of urea formaldehyde, phosphorous, and potassium in the following composition:
 1. Composition: 1 lb/1000 sq. ft. of actual nitrogen, 4 percent phosphorous, and 2 percent potassium, by weight.
- B. Slow-Release Fertilizer: Granular or pelleted fertilizer consisting of 50 percent water-insoluble nitrogen, phosphorus, and potassium in the following composition:
 1. Composition: 20 percent nitrogen, 10 percent phosphorous, and 10 percent potassium, by weight.

2.3 MULCHES

- A. Straw Mulch: Provide air-dry, clean, mildew- and seed-free, salt hay or threshed straw of wheat, rye, oats, or barley.
- B. Fiber Mulch: Biodegradable, dyed-wood, cellulose-fiber mulch; nontoxic and free of plant-growth or germination inhibitors; with a maximum moisture content of 15 percent and a pH range of 4.5 to 6.5.
- C. Nonasphaltic Tackifier: Colloidal tackifier recommended by fiber-mulch manufacturer for slurry application; nontoxic and free of plant-growth or germination inhibitors.

- D. Asphalt Emulsion: ASTM D 977, Grade SS-1; nontoxic and free of plant-growth or germination inhibitors.

2.4 PESTICIDES

- A. General: Pesticide, registered and approved by the EPA, acceptable to authorities having jurisdiction, and of type recommended by manufacturer for each specific problem and as required for Project conditions and application. Do not use restricted pesticides unless authorized in writing by authorities having jurisdiction.
- B. Pre-Emergent Herbicide (Selective and Nonselective): Effective for controlling the germination or growth of weeds within planted areas at the soil level directly below the mulch layer.
- C. Post-Emergent Herbicide (Selective and Nonselective): Effective for controlling weed growth that has already germinated.

2.5 EROSION-CONTROL MATERIALS

- A. Erosion-Control Blankets: Biodegradable wood excelsior, straw, or coconut-fiber mat enclosed in a photodegradable plastic mesh. Include manufacturer's recommended steel wire staples, 6 inches long.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas to be planted for compliance with requirements and other conditions affecting installation and performance of the Work.
 - 1. Verify that no foreign or deleterious material or liquid such as paint, paint washout, concrete slurry, concrete layers or chunks, cement, plaster, oils, gasoline, diesel fuel, paint thinner, turpentine, tar, roofing compound, or acid has been deposited in soil within a planting area.
 - 2. Suspend planting operations during periods of excessive soil moisture until the moisture content reaches acceptable levels to attain the required results.
 - 3. Uniformly moisten excessively dry soil that is not workable or which is dusty.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.
- C. If contamination by foreign or deleterious material or liquid is present in soil within a planting area, remove the soil and contamination as directed by Architect and replace with new planting soil.

3.2 PREPARATION

- A. Protect structures; utilities; sidewalks; pavements; and other facilities, trees, shrubs, and plantings from damage caused by planting operations.

1. Protect adjacent and adjoining areas from hydroseeding and hydromulching overspray.
 2. Protect grade stakes set by others until directed to remove them.
- B. Install erosion-control measures to prevent erosion or displacement of soils and discharge of soil-bearing water runoff or airborne dust to adjacent properties and walkways.

3.3 TURF AREA PREPARATION

- A. General: Prepare planting area for soil placement and mix planting soil according to Section 329115 "Soil Preparation (Performance Specification)."
- B. Placing Planting Soil: Place and mix planting soil in place over exposed subgrade.
1. Reduce elevation of planting soil to allow for soil thickness of sod.
- C. Moisten prepared area before planting if soil is dry. Water thoroughly and allow surface to dry before planting. Do not create muddy soil.
- D. Before planting, obtain Architect's acceptance of finish grading; restore planting areas if eroded or otherwise disturbed after finish grading.

3.4 PREPARATION FOR EROSION-CONTROL MATERIALS

- A. Prepare area as specified in "Turf Area Preparation" Article.
- B. For erosion-control mats, install planting soil in two lifts, with second lift equal to thickness of erosion-control mats. Install erosion-control mat and fasten as recommended by material manufacturer.
- C. Fill cells of erosion-control mat with planting soil and compact before planting.
- D. For erosion-control blanket or mesh, install from top of slope, working downward, and as recommended by material manufacturer for site conditions. Fasten as recommended by material manufacturer.
- E. Moisten prepared area before planting if surface is dry. Water thoroughly and allow surface to dry before planting. Do not create muddy soil.

3.5 SEEDING

- A. Sow seed with spreader or seeding machine. Do not broadcast or drop seed when wind velocity exceeds 5 mph.
1. Evenly distribute seed by sowing equal quantities in two directions at right angles to each other.
 2. Do not use wet seed or seed that is moldy or otherwise damaged.
 3. Do not seed against existing trees. Limit extent of seed to outside edge of planting saucer.
- B. Sow seed at a total rate of 5 to 8 lb/1000 sq. ft.

- C. Rake seed lightly into top 1/8 inch of soil, roll lightly, and water with fine spray.
- D. Protect seeded areas with slopes exceeding 1:4 with erosion-control blankets installed and stapled according to manufacturer's written instructions.
- E. Protect seeded areas with erosion-control mats where indicated on Drawings; install and anchor according to manufacturer's written instructions.
- F. Protect seeded areas with slopes not exceeding 1:6 by spreading straw mulch. Spread uniformly at a minimum rate of 2 tons/acre to form a continuous blanket in loose thickness over seeded areas. Spread by hand, blower, or other suitable equipment.
 - 1. Anchor straw mulch by crimping into soil with suitable mechanical equipment.
 - 2. Bond straw mulch by spraying with asphalt emulsion at a rate of 10 to 13 gal./1000 sq. ft.. Take precautions to prevent damage or staining of structures or other plantings adjacent to mulched areas. Immediately clean damaged or stained areas.
- G. Protect seeded areas from hot, dry weather or drying winds by applying water within 24 hours after completing seeding operations. Soak areas, scatter mulch uniformly and roll surface smooth.

3.6 HYDROSEEDING

- A. Hydroseeding: Mix specified seed, slow-release fertilizer, and fiber mulch in water, using equipment specifically designed for hydroseed application. Continue mixing until uniformly blended into homogeneous slurry suitable for hydraulic application.
 - 1. Mix slurry with fiber-mulch manufacturer's recommended tackifier.
 - 2. Spray-apply slurry uniformly to all areas to be seeded in a one-step process. Apply slurry at a rate so that mulch component is deposited at not less than 1500-lb/acre dry weight, and seed component is deposited at not less than the specified seed-sowing rate.

3.7 TURF MAINTENANCE

- A. General: Maintain and establish turf by watering, fertilizing, weeding, mowing, trimming, replanting, and performing other operations as required to establish healthy, viable turf. Roll, regrade, and replant bare or eroded areas and remulch to produce a uniformly smooth turf. Provide materials and installation the same as those used in the original installation.
 - 1. Fill in as necessary soil subsidence that may occur because of settling or other processes. Replace materials and turf damaged or lost in areas of subsidence.
 - 2. In areas where mulch has been disturbed by wind or maintenance operations, add new mulch and anchor as required to prevent displacement.
 - 3. Apply treatments as required to keep turf and soil free of pests and pathogens or disease. Use integrated pest management practices whenever possible to minimize the use of pesticides and reduce hazards.
- B. Watering: Install and maintain temporary piping, hoses, and turf-watering equipment to convey water from sources and to keep turf uniformly moist to a depth of 4 inches.

1. Schedule watering to prevent wilting, puddling, erosion, and displacement of seed or mulch. Lay out temporary watering system to avoid walking over muddy or newly planted areas.
 2. Water turf with fine spray at a minimum rate of 1 inch per week unless rainfall precipitation is adequate.
- C. Mow turf as soon as top growth is tall enough to cut. Repeat mowing to maintain specified height without cutting more than one-third of grass height. Remove no more than one-third of grass-leaf growth in initial or subsequent mowings. Do not delay mowing until grass blades bend over and become matted. Do not mow when grass is wet. Schedule initial and subsequent mowings to maintain the a height of 1 1/2 to 2 inches:

3.8 SATISFACTORY TURF

- A. Turf installations shall meet the following criteria as determined by Engineer:
1. Satisfactory Seeded Turf: At end of maintenance period, a healthy, uniform, close stand of grass has been established, free of weeds and surface irregularities, with coverage exceeding 90 percent over any 10 sq. ft. and bare spots not exceeding 5 by 5 inches.
 2. Satisfactory Sodded Turf: At end of maintenance period, a healthy, well-rooted, even-colored, viable turf has been established, free of weeds, open joints, bare areas, and surface irregularities.
- B. Use specified materials to reestablish turf that does not comply with requirements, and continue maintenance until turf is satisfactory.

3.9 PESTICIDE APPLICATION

- A. Apply pesticides and other chemical products and biological control agents according to requirements of authorities having jurisdiction and manufacturer's written recommendations. Coordinate applications with Owner's operations and others in proximity to the Work. Notify Owner before each application is performed.
- B. Post-Emergent Herbicides (Selective and Nonselective): Apply only as necessary to treat already-germinated weeds and according to manufacturer's written recommendations.

3.10 CLEANUP AND PROTECTION

- A. Promptly remove soil and debris created by turf work from paved areas. Clean wheels of vehicles before leaving site to avoid tracking soil onto roads, walks, or other paved areas.
- B. Remove surplus soil and waste material, including excess subsoil, unsuitable soil, trash, and debris, and legally dispose of them off Owner's property.
- C. Erect temporary fencing or barricades and warning signs as required to protect newly planted areas from traffic. Maintain fencing and barricades throughout initial maintenance period and remove after plantings are established.
- D. Remove non-degradable erosion-control measures after grass establishment period.

3.11 MAINTENANCE SERVICE

- A. Turf Maintenance Service: Provide full maintenance by skilled employees of landscape Installer. Maintain as required in "Turf Maintenance" Article. Begin maintenance immediately after each area is planted and continue until acceptable turf is established, but for not less than the following periods:
 - 1. Seeded Turf: 60 days from date of planting completion.
 - a. When initial maintenance period has not elapsed before end of planting season, or if turf is not fully established, continue maintenance during next planting season.

END OF SECTION 329200

SECTION 329300 - PLANTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:

1. Plants.
2. Tree stabilization.
3. Tree-watering devices.
4. Landscape edgings.
5. Tree grates.

- B. Related Requirements:

1. Section 329200 "Turf and Grasses" for turf (lawn) and meadow planting, hydroseeding, and erosion-control materials.

1.3 DEFINITIONS

- A. Backfill: The earth used to replace or the act of replacing earth in an excavation.
- B. Balled and Burlapped Stock: Plants dug with firm, natural balls of earth in which they were grown, with a ball size not less than sizes indicated; wrapped with burlap, tied, rigidly supported, and drum laced with twine with the root flare visible at the surface of the ball as recommended by ANSI Z60.1.
- C. Balled and Potted Stock: Plants dug with firm, natural balls of earth in which they are grown and placed, unbroken, in a container. Ball size is not less than sizes indicated.
- D. Bare-Root Stock: Plants with a well-branched, fibrous-root system developed by transplanting or root pruning, with soil or growing medium removed, and with not less than the minimum root spread according to ANSI Z60.1 for type and size of plant required.
- E. Container-Grown Stock: Healthy, vigorous, well-rooted plants grown in a container, with a well-established root system reaching sides of container and maintaining a firm ball when removed from container. Container shall be rigid enough to hold ball shape and protect root mass during shipping and be sized according to ANSI Z60.1 for type and size of plant required.
- F. Fabric Bag-Grown Stock: Healthy, vigorous, well-rooted plants established and grown in-ground in a porous fabric bag with well-established root system reaching sides of fabric bag.

Fabric bag size is not less than diameter, depth, and volume required by ANSI Z60.1 for type and size of plant.

- G. Finish Grade: Elevation of finished surface of planting soil.
- H. Pesticide: A substance or mixture intended for preventing, destroying, repelling, or mitigating a pest. Pesticides include insecticides, miticides, herbicides, fungicides, rodenticides, and molluscicides. They also include substances or mixtures intended for use as a plant regulator, defoliant, or desiccant. Some sources classify herbicides separately from pesticides.
- I. Pests: Living organisms that occur where they are not desired or that cause damage to plants, animals, or people. Pests include insects, mites, grubs, mollusks (snails and slugs), rodents (gophers, moles, and mice), unwanted plants (weeds), fungi, bacteria, and viruses.
- J. Planting Area: Areas to be planted.
- K. Planting Soil: Existing, on-site soil; imported soil; or manufactured soil that has been modified with soil amendments and perhaps fertilizers to produce a soil mixture best for plant growth. See Section 329115 "Soil Preparation (Performance Specification)" for drawing designations for planting soils.
- L. Plant; Plants; Plant Material: These terms refer to vegetation in general, including trees, shrubs, vines, ground covers, ornamental grasses, bulbs, corms, tubers, or herbaceous vegetation.
- M. Root Flare: Also called "trunk flare." The area at the base of the plant's stem or trunk where the stem or trunk broadens to form roots; the area of transition between the root system and the stem or trunk.
- N. Stem Girdling Roots: Roots that encircle the stems (trunks) of trees below the soil surface.
- O. Subgrade: The surface or elevation of subsoil remaining after excavation is complete, or the top surface of a fill or backfill before planting soil is placed.

1.4 COORDINATION

- A. Coordination with Turf Areas (Lawns): Plant trees, shrubs, and other plants after finish grades are established and before planting turf areas unless otherwise indicated.
 - 1. When planting trees, shrubs, and other plants after planting turf areas, protect turf areas, and promptly repair damage caused by planting operations.

1.5 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 - 1. Plant Materials: Include quantities, sizes, quality, and sources for plant materials.

1.6 INFORMATIONAL SUBMITTALS

- A. Product Certificates: For each type of manufactured product, from manufacturer, and complying with the following:
 - 1. Manufacturer's certified analysis of standard products.
 - 2. Analysis of other materials by a recognized laboratory made according to methods established by the Association of Official Analytical Chemists, where applicable.
- B. Pesticides and Herbicides: Product label and manufacturer's application instructions specific to Project.

1.7 CLOSEOUT SUBMITTALS

- A. Maintenance Data: Recommended procedures to be established by Owner for maintenance of plants during a calendar year. Submit before expiration of required maintenance periods.

1.8 DELIVERY, STORAGE, AND HANDLING

- A. Packaged Materials: Deliver packaged materials in original, unopened containers showing weight, certified analysis, name and address of manufacturer, and indication of compliance with state and Federal laws if applicable.
- B. Deliver bare-root stock plants within 24 hours of digging. Immediately after digging up bare-root stock, pack root system in wet straw, hay, or other suitable material to keep root system moist until planting. Transport in covered, temperature-controlled vehicles, and keep plants cool and protected from sun and wind at all times.
- C. Do not prune trees and shrubs before delivery. Protect bark, branches, and root systems from sun scald, drying, wind burn, sweating, whipping, and other handling and tying damage. Do not bend or bind-tie trees or shrubs in such a manner as to destroy their natural shape. Provide protective covering of plants during shipping and delivery. Do not drop plants during delivery and handling.
- D. Handle planting stock by root ball.
- E. Store bulbs, corms, and tubers in a dry place at 60 to 65 deg F until planting.
- F. Apply antidesiccant to trees and shrubs using power spray to provide an adequate film over trunks (before wrapping), branches, stems, twigs, and foliage to protect during digging, handling, and transportation.
 - 1. If deciduous trees or shrubs are moved in full leaf, spray with antidesiccant at nursery before moving and again two weeks after planting.
- G. Wrap trees and shrubs with burlap fabric over trunks, branches, stems, twigs, and foliage to protect from wind and other damage during digging, handling, and transportation.
- H. Deliver plants after preparations for planting have been completed, and install immediately. If planting is delayed more than six hours after delivery, set plants and trees in their appropriate

aspect (sun, filtered sun, or shade), protect from weather and mechanical damage, and keep roots moist.

1. Heel-in bare-root stock. Soak roots that are in less than moist condition in water for two hours. Reject plants with dry roots.
2. Set balled stock on ground and cover ball with soil, peat moss, sawdust, or other acceptable material.
3. Do not remove container-grown stock from containers before time of planting.
4. Water root systems of plants stored on-site deeply and thoroughly with a fine-mist spray. Water as often as necessary to maintain root systems in a moist, but not overly wet condition.

1.9 FIELD CONDITIONS

- A. Field Measurements: Verify actual grade elevations, service and utility locations, irrigation system components, and dimensions of plantings and construction contiguous with new plantings by field measurements before proceeding with planting work.
 1. Contractor shall stake proposed planting locations for review and approval prior to planting.
- B. Planting Restrictions: Plant during one of the following periods. Coordinate planting periods with maintenance periods to provide required maintenance from date of Substantial Completion.
 1. Spring Planting: May 1 to June 15.
 2. Fall Planting: September 15 to ground freeze.
- C. Weather Limitations: Proceed with planting only when existing and forecasted weather conditions permit planting to be performed when beneficial and optimum results may be obtained. Apply products during favorable weather conditions according to manufacturer's written instructions and warranty requirements.

1.10 WARRANTY

- A. Special Warranty: Installer agrees to repair or replace plantings and accessories that fail in materials, workmanship, or growth within specified warranty period.
 1. Failures include, but are not limited to, the following:
 - a. Death and unsatisfactory growth, except for defects resulting from abuse, lack of adequate maintenance, or neglect by Owner.
 - b. Structural failures including plantings falling or blowing over.
 - c. Faulty performance of tree stabilization.
 - d. Deterioration of metals, metal finishes, and other materials beyond normal weathering.
 2. Warranty Periods: From date of Substantial Completion.
 - a. Trees, Shrubs, Vines, and Ornamental Grasses: 12 months.

- b. Ground Covers, Biennials, Perennials, and Other Plants: 12 months.
 - c. Annuals: Three months.
3. Include the following remedial actions as a minimum:
- a. Immediately remove dead plants and replace unless required to plant in the succeeding planting season.
 - b. Replace plants that are more than 25 percent dead or in an unhealthy condition at end of warranty period.
 - c. A limit of one replacement of each plant is required except for losses or replacements due to failure to comply with requirements.
 - d. Provide extended warranty for period equal to original warranty period, for replaced plant material.

PART 2 - PRODUCTS

2.1 PLANT MATERIAL

- A. General: Furnish nursery-grown plants true to genus, species, variety, cultivar, stem form, shearing, and other features indicated in Plant List, Plant Schedule, or Plant Legend indicated on Drawings and complying with ANSI Z60.1; and with healthy root systems developed by transplanting or root pruning. Provide well-shaped, fully branched, healthy, vigorous stock, densely foliated when in leaf and free of disease, pests, eggs, larvae, and defects such as knots, sun scald, injuries, abrasions, and disfigurement.
 - 1. Trees with damaged, crooked, or multiple leaders; tight vertical branches where bark is squeezed between two branches or between branch and trunk ("included bark"); crossing trunks; cut-off limbs more than 3/4 inch (19 mm) in diameter; or with stem girdling roots are unacceptable.
 - 2. Collected Stock: Do not use plants harvested from the wild, from native stands, from an established landscape planting, or not grown in a nursery unless otherwise indicated.
- B. Provide plants of sizes, grades, and ball or container sizes complying with ANSI Z60.1 for types and form of plants required. Plants of a larger size may be used if acceptable to Architect, with a proportionate increase in size of roots or balls.
- C. Root-Ball Depth: Furnish trees and shrubs with root balls measured from top of root ball, which begins at root flare according to ANSI Z60.1. Root flare shall be visible before planting.
- D. Labeling: Label each plant of each variety, size, and caliper with a securely attached, waterproof tag bearing legible designation of common name and full scientific name, including genus and species. Include nomenclature for hybrid, variety, or cultivar, if applicable for the plant.
- E. If formal arrangements or consecutive order of plants is indicated on Drawings, select stock for uniform height and spread, and number the labels to assure symmetry in planting.
- F. Annuals: Provide healthy, disease-free plants of species and variety shown or listed, with well-established root systems reaching to sides of the container to maintain a firm ball, but not with

excessive root growth encircling the container. Provide only plants that are acclimated to outdoor conditions before delivery.

2.2 FERTILIZERS

- A. Planting Tablets: Tightly compressed chip-type, long-lasting, slow-release, commercial-grade planting fertilizer in tablet form. Tablets shall break down with soil bacteria, converting nutrients into a form that can be absorbed by plant roots.
 - 1. Size: 10-gram tablets.
 - 2. Nutrient Composition: 20 percent nitrogen, 10 percent phosphorous, and 5 percent potassium, by weight plus micronutrients.

2.3 MULCHES

- A. Organic Mulch: Free from deleterious materials and suitable as a top dressing of trees and shrubs, consisting of one of the following:
 - 1. Type: Shredded hardwood.
 - 2. Size Range: 3 inches maximum, 1/2 inch minimum.
 - 3. Color: Natural.

2.4 WEED-CONTROL BARRIERS

- A. Nonwoven Geotextile Filter Fabric: Polypropylene or polyester fabric, 3 oz./sq. yd. minimum, composed of fibers formed into a stable network so that fibers retain their relative position. Fabric shall be inert to biological degradation and resist naturally encountered chemicals, alkalis, and acids.
- B. Composite Fabric: Woven, needle-punched polypropylene substrate bonded to a nonwoven polypropylene fabric, 4.8 oz./sq. yd.

2.5 PESTICIDES

- A. General: Pesticide registered and approved by the EPA, acceptable to authorities having jurisdiction, and of type recommended by manufacturer for each specific problem and as required for Project conditions and application. Do not use restricted pesticides unless authorized in writing by authorities having jurisdiction.
- B. Pre-Emergent Herbicide (Selective and Nonselective): Effective for controlling the germination or growth of weeds within planted areas at the soil level directly below the mulch layer.
- C. Post-Emergent Herbicide (Selective and Nonselective): Effective for controlling weed growth that has already germinated.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas to receive plants, with Installer present, for compliance with requirements and conditions affecting installation and performance of the Work.
 - 1. Verify that no foreign or deleterious material or liquid such as paint, paint washout, concrete slurry, concrete layers or chunks, cement, plaster, oils, gasoline, diesel fuel, paint thinner, turpentine, tar, roofing compound, or acid has been deposited in soil within a planting area.
 - 2. Verify that plants and vehicles loaded with plants can travel to planting locations with adequate overhead clearance.
 - 3. Suspend planting operations during periods of excessive soil moisture until the moisture content reaches acceptable levels to attain the required results.
 - 4. Uniformly moisten excessively dry soil that is not workable or which is dusty.
- B. If contamination by foreign or deleterious material or liquid is present in soil within a planting area, remove the soil and contamination as directed by Architect and replace with new planting soil.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Protect structures, utilities, sidewalks, pavements, and other facilities and turf areas and existing plants from damage caused by planting operations.
- B. Install erosion-control measures to prevent erosion or displacement of soils and discharge of soil-bearing water runoff or airborne dust to adjacent properties and walkways.
- C. Lay out individual tree and shrub locations and areas for multiple plantings. Stake locations, outline areas, adjust locations when requested, and obtain Architect's acceptance of layout before excavating or planting. Make minor adjustments as required.
- D. Lay out plants at locations directed by Architect. Stake locations of individual trees and shrubs and outline areas for multiple plantings.

3.3 PLANTING AREA ESTABLISHMENT

- A. General: Prepare planting area for soil placement and mix planting soil according to Section 329115 "Soil Preparation (Performance Specification)."
- B. Placing Planting Soil: Place and mix planting soil in-place over exposed subgrade.
- C. Before planting, obtain Engineer's acceptance of finish grading; restore planting areas if eroded or otherwise disturbed after finish grading.

- D. Application of Mycorrhizal Fungi: At time directed by Engineer, broadcast dry product uniformly over prepared soil at application rate according to manufacturer's written recommendations.

3.4 EXCAVATION FOR TREES AND SHRUBS

- A. Planting Pits and Trenches: Excavate circular planting pits.
 - 1. Excavate planting pits with sides sloping inward at a 45-degree angle. Excavations with vertical sides are unacceptable. Trim perimeter of bottom leaving center area of bottom raised slightly to support root ball and assist in drainage away from center. Do not further disturb base. Ensure that root ball will sit on undisturbed base soil to prevent settling. Scarify sides of planting pit smeared or smoothed during excavation.
 - 2. Excavate approximately three times as wide as ball diameter for balled and burlapped stock.
 - 3. Excavate at least 12 inches wider than root spread and deep enough to accommodate vertical roots for bare-root stock.
 - 4. Do not excavate deeper than depth of the root ball, measured from the root flare to the bottom of the root ball.
 - 5. If area under the plant was initially dug too deep, add soil to raise it to the correct level and thoroughly tamp the added soil to prevent settling.
 - 6. Maintain angles of repose of adjacent materials to ensure stability. Do not excavate subgrades of adjacent paving, structures, hardscapes, or other new or existing improvements.
 - 7. Maintain supervision of excavations during working hours.
 - 8. Keep excavations covered or otherwise protected when unattended by Installer's personnel.
 - 9. If drain tile is indicated on Drawings or required under planting areas, excavate to top of porous backfill over tile.
- B. Backfill Soil: Subsoil and topsoil removed from excavations may be used as backfill soil unless otherwise indicated.
- C. Obstructions: Notify Engineer if unexpected rock or obstructions detrimental to trees or shrubs are encountered in excavations.
 - 1. Hardpan Layer: Drill 6-inch diameter holes, 24 inches apart, into free-draining strata or to a depth of 10 feet, whichever is less, and backfill with free-draining material.
- D. Drainage: Notify Engineer if subsoil conditions evidence unexpected water seepage or retention in tree or shrub planting pits.
- E. Fill excavations with water and allow to percolate away before positioning trees and shrubs.

3.5 TREE, SHRUB, AND VINE PLANTING

- A. Inspection: At time of planting, verify that root flare is visible at top of root ball according to ANSI Z60.1. If root flare is not visible, remove soil in a level manner from the root ball to

where the top-most root emerges from the trunk. After soil removal to expose the root flare, verify that root ball still meets size requirements.

- B. Roots: Remove stem girdling roots and kinked roots. Remove injured roots by cutting cleanly; do not break.
- C. Balled and Burlapped Stock: Set each plant plumb and in center of planting pit or trench with root flare 2 inch above adjacent finish grades.
 - 1. Backfill: Planting soil For trees, use excavated soil for backfill.
 - 2. After placing some backfill around root ball to stabilize plant, carefully cut and remove burlap, rope, and wire baskets from tops of root balls and from sides, but do not remove from under root balls. Remove pallets, if any, before setting. Do not use planting stock if root ball is cracked or broken before or during planting operation.
 - 3. Backfill around root ball in layers, tamping to settle soil and eliminate voids and air pockets. When planting pit is approximately one-half filled, water thoroughly before placing remainder of backfill. Repeat watering until no more water is absorbed.
 - 4. Place planting tablets equally distributed around each planting pit when pit is approximately one-half filled. Place tablets beside the root ball about 1 inch from root tips; do not place tablets in bottom of the hole.
 - a. Quantity: Three for each caliper inch of plant.
 - 5. Continue backfilling process. Water again after placing and tamping final layer of soil.
- D. Bare-Root Stock: Set and support each plant in center of planting pit or trench with root flares 2 inches adjacent finish grade.
 - 1. Backfill: Planting soil for trees, use excavated soil for backfill
 - 2. Spread roots without tangling or turning toward surface. Plumb before backfilling, and maintain plumb while working.
 - 3. Carefully work backfill in layers around roots by hand. Bring roots into close contact with the soil.
 - 4. When planting pit is approximately one-half filled, water thoroughly before placing remainder of backfill. Repeat watering until no more water is absorbed.
 - 5. Place planting tablets equally distributed around each planting pit when pit is approximately one-half filled. Place tablets beside soil-covered roots about 1 inch from root tips; do not place tablets in bottom of the hole or touching the roots.
 - a. Quantity: Three for each caliper inch of plant.
 - 6. Continue backfilling process. Water again after placing and tamping final layer of soil.
- E. Slopes: When planting on slopes, set the plant so the root flare on the uphill side is flush with the surrounding soil on the slope; the edge of the root ball on the downhill side will be above the surrounding soil. Apply enough soil to cover the downhill side of the root ball.

3.6 MECHANIZED TREE-SPADE PLANTING

- A. Trees may be planted with an approved mechanized tree spade at the designated locations. Do not use tree spade to move trees larger than the maximum size allowed for a similar field-grown, balled-and-burlapped root-ball diameter according to ANSI Z60.1, or larger than manufacturer's maximum size recommendation for the tree spade being used, whichever is smaller.
- B. Use the same tree spade to excavate the planting hole as will be used to extract and transport the tree.
- C. When extracting the tree, center the trunk within the tree spade and move tree with a solid ball of earth.
- D. Cut exposed roots cleanly during transplanting operations.
- E. Plant trees following procedures in "Tree, Shrub, and Vine Planting" Article.
- F. Where possible, orient the tree in the same direction as in its original location.

3.7 TREE, SHRUB, AND VINE PRUNING

- A. Remove only dead, dying, or broken branches. Do not prune for shape.
- B. Prune, thin, and shape trees, shrubs, and vines as directed by Architect.
- C. Prune, thin, and shape trees, shrubs, and vines according to standard professional horticultural and arboricultural practices. Unless otherwise indicated by Architect, do not cut tree leaders; remove only injured, dying, or dead branches from trees and shrubs; and prune to retain natural character.
- D. Do not apply pruning paint to wounds.

3.8 TREE STABILIZATION

- A. Root-Ball Stabilization: Install at- or below-grade stabilization system to secure each new planting by the root ball unless otherwise indicated.
 - 1. Wood Hold-Down Method: Place vertical stakes against side of root ball and drive them into subsoil; place horizontal wood hold-down stake across top of root ball and screw at each end to one of the vertical stakes.
 - a. Install stakes of length required to penetrate at least 18 inches below bottom of backfilled excavation. Saw stakes off at horizontal stake.
 - b. Install screws through horizontal hold-down and penetrating at least 1 inch into stakes. Predrill holes if necessary to prevent splitting wood.
 - c. Install second set of stakes on other side of root trunk for larger trees.

2. Proprietary Root-Ball Stabilization Device: Install root-ball stabilization system sized and positioned as recommended by manufacturer unless otherwise indicated and according to manufacturer's written instructions.

3.9 ROOT-BARRIER INSTALLATION

- A. Install root barrier where trees are planted within 48 inches of paving or other hardscape elements, such as walls, curbs, and walkways, unless otherwise indicated on Drawings.
- B. Align root barrier vertically, and run it linearly along and adjacent to the paving or other hardscape elements to be protected from invasive roots.
- C. Install root barrier continuously for a distance of 60 inches in each direction from the tree trunk, for a total distance of 10 feet per tree. If trees are spaced closer, use a single continuous piece of root barrier.
 1. Position top of root barrier according to manufacturer's written recommendations].
 2. Overlap root barrier a minimum of 12 inches at joints.
 3. Do not distort or bend root barrier during construction activities.
 4. Do not install root barrier surrounding the root ball of tree.

3.10 PLANTING AREA MULCHING

- A. Install weed-control barriers before mulching according to manufacturer's written instructions. Completely cover area to be mulched, overlapping edges a minimum of 6 inches and secure seams with galvanized pins.
- B. Mulch backfilled surfaces of planting areas and other areas indicated.
 1. Trees in Turf Areas: Apply organic] mulch ring of 3-inch average thickness, with 24-inch radius around trunks or stems. Do not place mulch within 3 inches of trunks or stems.

3.11 PLANT MAINTENANCE

- A. Maintain plantings by pruning, cultivating, watering, weeding, fertilizing, mulching, restoring planting saucers, adjusting and repairing tree-stabilization devices, resetting to proper grades or vertical position, and performing other operations as required to establish healthy, viable plantings.
- B. Fill in, as necessary, soil subsidence that may occur because of settling or other processes. Replace mulch materials damaged or lost in areas of subsidence.
- C. Apply treatments as required to keep plant materials, planted areas, and soils free of pests and pathogens or disease. Use integrated pest management practices when possible to minimize use of pesticides and reduce hazards. Treatments include physical controls such as hosing off foliage, mechanical controls such as traps, and biological control agents.

3.12 PESTICIDE APPLICATION

- A. Apply pesticides and other chemical products and biological control agents according to authorities having jurisdiction and manufacturer's written recommendations. Coordinate applications with Owner's operations and others in proximity to the Work. Notify Owner before each application is performed.
- B. Pre-Emergent Herbicides (Selective and Nonselective): Apply to tree, shrub, and ground-cover areas according to manufacturer's written recommendations. Do not apply to seeded areas.
- C. Post-Emergent Herbicides (Selective and Nonselective): Apply only as necessary to treat already-germinated weeds and according to manufacturer's written recommendations.

3.13 REPAIR AND REPLACEMENT

- A. General: Repair or replace existing or new trees and other plants that are damaged by construction operations, in a manner approved by Engineer.
 - 1. Submit details of proposed pruning and repairs.
 - 2. Perform repairs of damaged trunks, branches, and roots within 24 hours, if approved.
 - 3. Replace trees and other plants that cannot be repaired and restored to full-growth status, as determined by Engineer.
- B. Remove and replace trees that are more than 25 percent dead or in an unhealthy condition before the end of the corrections period or are damaged during construction operations that Engineer determines are incapable of restoring to normal growth pattern.
 - 1. Provide new trees of same size as those being replaced for each tree of 6 inches or smaller in caliper size.
 - 2. Provide one new tree(s) of 6-inch caliper size for each tree being replaced that measures more than 6 inches in caliper size.
 - 3. Species of Replacement Trees: Same species being replaced.

3.14 CLEANING AND PROTECTION

- A. During planting, keep adjacent paving and construction clean and work area in an orderly condition. Clean wheels of vehicles before leaving site to avoid tracking soil onto roads, walks, or other paved areas.
- B. Remove surplus soil and waste material including excess subsoil, unsuitable soil, trash, and debris and legally dispose of them off Owner's property.
- C. Protect plants from damage due to landscape operations and operations of other contractors and trades. Maintain protection during installation and maintenance periods. Treat, repair, or replace damaged plantings.
- D. After installation and before Substantial Completion remove nursery tags, nursery stakes, tie tape, labels, wire, burlap, and other debris from plant material, planting areas, and Project site.

3.15 MAINTENANCE SERVICE

- A. Maintenance Service for Trees and Shrubs: Provide maintenance by skilled employees of landscape Installer. Maintain as required in "Plant Maintenance" Article. Begin maintenance immediately after plants are installed and continue until plantings are acceptably healthy and well established, but for not less than maintenance period below:

- 1. Maintenance Period: 12 months from date of Substantial Completion.

END OF SECTION 329300

APPENDIX I

GLOSSARY

GLOSSARY

Activity—An element in the Progress Schedule establishing a requisite step, or the time and resources required, for completing the part of the Work associated with that Activity.

Addenda—Written instruments that are used by the Owner and/or Professional to incorporate interpretations or clarifications, modifications and other information into the Bidding Documents. An Addendum issued after Bid opening to those Bidders who actually submitted a Bid, for the purpose of re-bidding the Work without re-advertising, is referred to as a **post-Bid Addendum**.

Agency—Any unit, section, division, department or other instrumentality of the State that benefits from the Work.

Alternate—Refers to work specified in the Bidding Documents for which the Bidder must bid a Bid Price.

Apparent Low Bidders: Those Bidders whose Base Bid, when added to those specific Alternates the Owner intends to accept, yields the three lowest sums of Bid and Alternates. Additional Bidders may be considered Apparent Low Bidders if their Bid, when added to those specific Alternates the Owner intends to accept, yields a sum within 10% of the lowest of the Apparent Low Bidder's sum. If a qualified disabled veteran meets the requirements of the contract solicitation, provides acceptable responses to both Part One and Part Two of the Best Value Construction Bidder Evaluation to achieve a Best Value recommendation and with the veteran's preference is the lowest responsive, responsible, best value Bidder it is considered the Apparent Low Bidder.

Archaeological Feature—Any prehistoric or historic deposit of archaeological value, as determined by a representative of a State agency that is duly authorized to evaluate such findings and render such judgments. An Archaeological Feature deposit may include, but is not limited to Indian habitations, ceremonial sites, abandoned settlements, treasure trove, artifacts or other objects with intrinsic archaeological value and that relate to the history and culture of the State of Michigan. The Archaeological Features are listed under Section 00800 Supplementary Conditions.

Authorized Technical Data—Information and data contained in a report of exploration and tests of subsurface conditions. Also, any physical data (dimension, location, conditions, etc.) contained in those Drawings of physical conditions of existing surface and subsurface facilities.

Best Value—The bids will be evaluated for best value based on price and qualitative components that may include but are not limited to technical design, technical approach, quality of proposed personnel, and management plans, per PA 430 of 2012.

Bid—Written offer by a Bidder for the Work, as specified, which designates the Bidder's Base Bid and Bid Prices for all Alternates. The term *Bid* includes a *re-bid*.

Bidder—The Person acting directly, or through an authorized representative, who submits a Bid directly to the **Owner**.

Bidding Documents—The proposed Contract Documents as advertised, and all Addenda issued before execution of the Contract.

Bid Price—The Bidder's price for a lump sum item of work, or the product of the Bidder's unit price for an item of Unit Price Work times the quantity given on the Bid Form for that item.

Bid Security—Security serving as a guarantee that the Bidder will conform to all conditions.

Bidding Requirements—The Advertisement, Instructions to Bidders, Supplementary Instructions, Information for Bidders, Bid Form, Bid Form Attachments and qualification submittals, as advertised and as modified by Addenda, and any other Section included within Division 0 of the Bidding Documents for the purpose of governing bidding and award of the Contract.

Board—The Administrative Board of the State of Michigan.

Bond—Security furnished by the **Contractor**, as required by the Contract Documents.

Business Day—Any Day except Saturdays, Sundays and holidays observed by the **Owner**.

Bulletin—A request used by the **Owner** to describe a change in the Work under consideration by the **Owner** and to request the **Contractor** to submit a proposal for the corresponding adjustment in Contract Price and/or Contract Time, if any.

Calendar Day—Every day shown on the calendar, Saturdays, Sundays and holidays included.

Cash Allowance—An **Owner**-specified sum included within the Contract Price to reimburse the **Contractor** for the actual purchase/furnished cost of materials and/or equipment or other designated items, as specifically provided in the Contract Documents. Although the scope (e.g., the required quantity) of any Work covered by a Cash Allowance is sufficiently detailed in the

Contract Documents for the purposes of bidding the required labor costs, Subcontract costs, construction equipment costs and general conditions costs and Fee, it is understood that the required materials, equipment or other designated items are of uncertain purchase cost at the time of Bid or are yet to be specified in more detail by the **Professional** as to quality, appearance, durability, finish and such other necessary features affecting purchase price.

Change Order—A written order issued and signed by the **Owner**, which amends the Contract Documents for changes in the Work or an adjustment in Contract Price and/or Contract Time, or both.

Contract Award—The official action of the **Board**, the **Director-SFA** or the **Director-DCD** awarding the Contract to the **Contractor**.

Contract Documents—Written and graphic documents that form the legal agreement between the **Owner** and the **Contractor**, consisting of this document, completed Bid and Contract forms, terms and conditions of the contract, specifications, drawings, addenda, Notice of Award, Notice-to-Proceed and contract change orders.

Contract Price—The total compensation, including authorized adjustments, payable by the **Owner** to the **Contractor** (subject to provisions for Unit Price Work).

Contract Times—The Contract Times for the entire Work are the periods allowed, including authorized adjustments, for Substantial Completion and final completion of the Work. The Contract Times for a designated portion of the Work are the periods allowed for Substantial Completion and final completion of any such portion of the Work, as specified in the Contract Documents.

Contractor—Business enterprise with which the **Owner** has entered into the Contract.

Correction Period—Period during which the **Contractor** must, in accordance with the Contract Documents, (a) correct or, if rejected, remove and replace Defective Work, and (b) maintain warranties for materials and equipment in full force and effect.

Cost of the Work Involved—The sum of all costs that would be, or actually were, necessarily incurred by the **Contractor** in providing any Work Involved with the related change, less the costs that would be, or would have been, incurred by the **Contractor** to provide such Work without the related change.

Defective—As determined by the Professional, an adjective which when referring to or when applied to the term “Work” refers to (a) Work not conforming to the Contract Documents or not meeting the requirements of an inspection, test or approval, or (b) Work itemized in a Punch List which the **Contractor** fails to complete or correct within a reasonable time after issuance of the Punch List by the **Professional**.

Delay—Any act or omission or other event that in any manner adversely affects or alters the schedule, progress or completion of all or any part of the Work. Delay is a generic term intended to include deferral, stoppage, slow down, interruption and extended performance, and all related hindrance, rescheduling, disruption, interference, inefficiency and productivity and production losses.

Department (DTMB)—Department of Technology, Management and Budget of the State of Michigan.

Director is the Director of the **Department**.

Director-SFA is the Director of **DTMB** State Facilities Administration.

Director-DCD is the Director of **DTMB** State Facilities Administration, Design and Construction Division.

Division—Each of the numbered, distinct parts (starting with Division 0) into which the Specifications are divided.

Drawings—Part of the Contract Documents showing the Work. Drawings must neither serve nor be used as Shop Drawings.

Emergency—A condition affecting the safety or protection of persons, or the Work, or property at or adjacent to the site.

State Facilities Administration (SFA)—Entity in the **Department** responsible for design, construction, and operations and maintenance of facilities.

Fee for the Work Involved (Fee)—An established, percentage mark-up on the Cost of the Work Involved which is allowed to the **Contractor** for (a) reasonable administrative costs, and (b) negotiated, reasonable profit on the Cost of the Work Involved.

Hazardous Material—Asbestos containing materials (ACMs), Polychlorinated biphenyls (PCBs), petroleum products, such construction materials as paint thinners, solvents, gasoline, oil, etc., and any other like material the manufacture, use, treatment, storage, transportation or disposal of which is regulated by federal, State or local Laws governing the protection of public health, natural resources or the environment.

Invitation To Bid (ITB) -The solicitation document presenting the terms and conditions that will become part of the Contract when the Bid is accepted.

Law(s)–Means federal, State and local statutes, ordinances, orders, rules and/or regulations.

MCL–The Michigan Compiled Laws of the State of Michigan.

Means and Methods–Includes means, methods, techniques, sequences and/or procedures applicable to the Work.

Notice of Award–Written notice accepting the Bid to the lowest responsive, responsible Bidder and designating the Contract Price (and establishing the Alternates accepted by the **Owner**).

Notice-to-Proceed–Written notice issued by the Project Director directing the Contractor to commence the construction activities and establishing the start date of the Contract Time.

On-Site Inspection–The **Professional's** on-site examination of the **Contractor's** completed or in progress Work to determine and verify to the Project Director that the quantity and quality of all Work complies with the requirements of the Contract Documents.

Owner–The State of Michigan, with whom the **Contractor** has entered into the Contract and for whom the Work is to be provided.

Owner Field Representative–A State employee or consultant, acting collaboratively with the Project Director, providing on-site, periodic observation and documentation of the Work for compliance with the Contract Documents.

Partial Use–Use by the **Owner** of a designated portion of the Work before accomplishing Substantial Completion of the entire Work. Partial Use does not mean Substantial Completion of the portion of the Work placed in use by the **Owner**.

Person–Individuals, partnerships, corporations, receivers, trustees, joint ventures or any other legal entity and any combinations of any of them.

Political Subdivision–Any county, city, village or other local unit of the State, including any agency, department or instrumentality of any such county, city, village or other local unit.

Post-Bid Submittal–A Qualification Submittal required of the Bidder selected under Section 00100 - 22 before Contract Award, and which is used by the Owner in the evaluation of the Bid of the selected Bidder.

Professional Services Contractor (PSC or Professional)–The individual or business entity who has the authority to practice the design disciplines required by the Contract Documents. An Agency with appropriate licensing may replace the PSC in their role if a consultant is not used.

Project–The total construction, which includes the Work and possibly other work completed by others, as indicated in the Contract Documents.

Project Director–Designated State employee(s) (a) Responsible for directing and supervising the **Professional's** services during the period allowed for completion of the Work; and/or (b) Acting as representative for the **Owner** and for the enforcement of the Contract Documents, approving payment to the **Contractor** and coordinating the activities of the State, **Owner, Professional** and **Contractor**.

Project Schedule–Work Schedule that shows the **Contractor's** approach to planning, scheduling and execution of the Work and that accurately portrays completed Work as to sequencing and timing, as provided in the Contract Documents.

Project Specifications–The Contract Documents organized into Divisions. "Technical Specifications" means Divisions of the Specifications consisting of technical descriptions of materials, equipment, construction systems, standards and workmanship.

Provisionary Allowance–An amount included within the Contract Price to reimburse the **Contractor** for the cost to furnish and perform Work that is uncertain because, for example, it is indeterminate in scope and may not be shown or detailed in the Contract Documents.

Punch List–A list of minor items to be completed or corrected by the **Contractor**, any one of which do not materially impair the use of the Work for its intended purpose.

Qualified Disabled Veteran (QDV)–QDV as defined by Public Act 22 of 2010, MCL 18.1241.3 and supported by a DD214 Proof of Service and Discharge, a Veterans Administration rating decision letter, proof of disability (if the disability is not indicated on the DD214), and appropriate legal documents setting forth the 51% natural persons QDV ownership.

Record Documents—Drawings, Specifications, Addenda, Change Orders, Change Authorizations, Bulletins, inspection, test and approval reports, photographs, written clarifications and interpretations and all other documents recording, or annotated to show, all revisions and deviations between the as-built installation and the Contract Documents, all approved Submittals and all clarifications and interpretations.

Records—Books, reports, documents, electronic data, and other evidence relating to the bidding, award and furnishing and performance of the Work.

Recycled Material—Recycled paper products, structural materials made from recycled plastics, re-refined lubricating oils, reclaimed solvents, recycled asphalt and concrete, recycled glass products, re-treaded tires, ferrous metals containing recycled scrap metals and all other materials that contain (a) waste materials generated by a business or consumer, (b) materials that have served their intended purpose, and/or (c) materials that have been separated from solid waste for collection, recycling and disposition in the percentage determined by the State as provided by Law.

Request for Payment—The form provided by the **Owner** (Payment Request DTMB-0440) to be used by the **Contractor** in requesting payment for Work completed, which must enclose all supporting information required by the Contract Documents.

Schedule of Values—A schedule of pay items, which subdivides the Work into its various parts and which details, for each itemized part, cost and pricing information required for making payments for Work performed. The sum of all pay item costs in the Schedule of Values must equal the Contract Price for the Work.

Shop Drawings—Includes drawings, diagrams, illustrations, standard schedules, performance charts, instructions and other data prepared by or for the **Contractor** to illustrate some part of the Work, or by a Supplier and submitted by the **Contractor** to illustrate items of material or equipment.

Soil Erosion and Sedimentation Control—The planning, design and installation of appropriate Best Management Practices designed and engineered specifically to reduce or eliminate the off-site migration of soils via water runoff, wind, vehicle tracking, etc. Soil erosion and sedimentation control in the State of Michigan is regulated under The Natural Resources Environmental Protection Act; Soil Erosion and Sedimentation Control, 1994 PA 451, Part 91, as amended, MCL 324.9101 et seq. Soil erosion and sedimentation control associated with this Contract is monitored and enforced by the DTMB-SFA.

State—The State of Michigan in its governmental capacity, including its departments, divisions, agencies, boards, offices, commissions, officers, employees and agents. Non-capitalized references to a state refer to a state other than the State of Michigan.

State Construction Code—The Michigan State Construction Code Act, 1972 PA 230, as amended, MCL 125.1501 et seq.

Subcontractor—A Person having an agreement with the Contractor to provide labor at the site and furnishing materials and/or equipment for incorporation into the Work.

Submittals—Includes technical Submittals, Progress Schedules and those other documents required for submission by the Contract Documents. The term "technical Submittal" includes Shop Drawings, brochures, samples, Operation and Maintenance (O&M) Manuals, test procedures and any other Submittal the Contract Documents require the **Contractor** to submit to demonstrate how the items covered, after installation or incorporation into the Work, will conform to the information given in the Contract Documents and be compatible with the design of the completed Work as a functioning whole as indicated in the Contract Documents.

Substantial Completion—The Work, or a portion of the Work designated in the Contract Documents as eligible for separate Substantial Completion, has been completed in accordance with the Contract Documents as determined by the PSC, to the extent that the **Owner** can use or occupy the entire Work, or the designated portion of the Work, for the use intended without any outstanding, concurrent Work at the site, except as may be required to complete or correct Punch List items.

Supplier—A manufacturer or fabricator, or a distributor, material man or vendor representing a manufacturer or fabricator, who has an agreement with the Contractor to furnish materials and/or equipment.

Underground Utilities—Pipelines, piping, conduit, duct, cables, wells, tanks, tunnels and appurtenances, or other similar facilities, installed underground to convey or support conveyance of potable water, sprinkler or irrigation water, fire protection systems, electricity, gases, steam, petroleum products, sewerage and drainage removal, telephone, communications, cable TV, traffic or control systems.

Unit Price Work—Work involving specified quantities (i.e., related Work quantities) which when performed is measured by the **Professional** and paid using the measured quantities and unit prices contained in the Contract Documents. Performance of Unit Price Work for undefined quantities is contingent upon conditions encountered at the site, as determined and authorized by the **Professional**.

Unit Price Work, Specified—Work of specified and defined quantities (i.e., quantities are detailed in, and can be taken-off from, the Contract Documents) that when performed is measured by the **Professional** and paid based on the measured quantities and unit prices contained in the Contract Documents.

Work (as in “*the Work*,” “*the entire Work*”)—The entire *completed Construction* required by the Contract Documents. The Work results from furnishing and performing all services, obligations, responsibilities, management, supervision, labor, materials, equipment, construction equipment, general conditions, permits, taxes, patent fees and royalties, testing, inspection and approval responsibilities, warranties, temporary facilities, small tools, field supplies, Bonds, insurance, mobilization, close-out, overhead and all connections, devices and incidental items of any kind or nature required and/or made necessary by the Contract Documents.

Work Involved, any Work Involved—Existing or prospective Work (a) reflected in any notice, proposal or claim, or (b) reflected in changes ordered or in process, or (c) affected by Delay.

APPENDIX II
SPECIAL WORKING CONDITIONS

DEPARTMENT OF NATURAL RESOURCES

The Work comprising this Project will be performed at a site of the Department of Natural Resources. The Contractor must comply with all rules and regulations pertaining to such sites and must conform to the following rules:

1. The Contractor must provide a competent Superintendent satisfactory to the Department of Natural Resources on the work site at all times during working hours with full authority to act for him. It must be the Contractor's responsibility to furnish the Department of Natural Resources with the name, address and telephone number of the responsible person to contact for Emergency during after hour, weekend and holiday periods.
2. Access to and egress from the site must be via routes specifically designated by the Department of Natural Resources authorized representative.
3. All work will be coordinated so as to minimally interfere with the normal function of the boating access site which will be open and operational between the spring opening and fall closing. Specifically,
 - 3.1 No Work must be performed at the site on Saturdays, Sundays, holidays or during night hours without the written permission from the Department of Natural Resources; and
4. Areas on the site for employee parking, tool boxes, material lay down, etc., must be assigned by the Department of Natural Resources. All firearms, weapons, alcoholic beverages, or explosives must be removed from vehicles before entering the site.
5. Heavy equipment such as bulldozers and power shovels must be locked or immobilized in an acceptable manner when not in use. No tools, small pipe, copper or wire must remain on the site overnight, unless acceptably locked inside shanties or tool chests. There will be no exchange, loaning or borrowing of tools, equipment or manpower between the Department of Natural Resources and the Contractor.
6. The Contractor must comply with the special condition requirements of the Department of Natural Resources and the United States Army Corps of Engineers Permit Sections appended to these specifications.
7. Work Schedule:
 - 7.1 Work shall be scheduled such that it can be completed in a continuous manner without shutdowns or delays. Hot mix asphalt is not always readily available in this area. Schedule work to allow HMA paving to occur when progress allows.

APPENDIX III
SPECIAL PROJECT PROCEDURES

SOIL EROSION AND SEDIMENTATION CONTROL PROJECT PROCEDURES FOR CONTRACTORS ON DTMB OWNED AND MANAGED PROPERTIES

1. Comply with Part 91, Soil Erosion and Sedimentation Control of the Natural Resources and Environmental Protection Act 1994 PA 451, as amended.
2. Contact the DTMB, SFA, Design and Construction Division to discuss the implementation of soil erosion and sedimentation control (SESC) on the Project with DTMB SESC Officer. Phone (517) 388-3045 or Email mcgarryc@michigan.gov.
3. Following the award of a contract, the Contractor will be required to prepare and issue for approval an SESC Implementation Plan, which indicates the Contractor's intended implementation of SESC on the project including a schedule and sequence. The Environmental Health and Safety Section, upon approval of the implementation plan, will issue to the Contractor an "Authorization to Proceed with Earth Change" document, which is to be posted at the job site. This document is issued in lieu of a permit from the county. Earthwork shall not begin prior to the issuance of this Authorization. Upon receipt of the Authorization document, the Contractor may begin earth change activities.
4. See below the "Checklist for Contractor's SESC Implementation Plan" for details of the required information necessary for the Contractor to create the SESC Implementation Plan. The intent of this plan is to ensure that the Contractor has reviewed and understands the SESC provisions within the plans and specifications.
5. CHECKLIST FOR CONTRACTOR'S SOIL EROSION AND SEDIMENTATION CONTROL IMPLEMENTATION PLAN (For projects that include earth changes or disturb existing vegetation):

DEPARTMENT OF TECHNOLOGY, MANAGEMENT AND BUDGET
STATE FACILITIES ADMINISTRATION, DESIGN AND CONSTRUCTION DIVISION
SOIL EROSION AND SEDIMENTATION CONTROL PROGRAM
P.O. Box 30026, Lansing, Michigan 48909

PROJECT TITLE: COUNTY LINE BOATING ACCESS SITE IMPROVEMENTS
PROJECT LOCATION: BIG MANISTIQUE LAKE, CURTIS, LUCE COUNTY, MICHIGAN
PROJECT FILE NUMBER: 751/18095.TAP
INDEX NUMBER: 5200

Prior to the start of earthwork, the Contractor must submit a Soil Erosion and Sedimentation Control (SESC) Implementation Plan to the Michigan Department of Technology, Management and Budget, Soil Erosion and Sedimentation Control Program. The intent of this plan is to ensure that the Contractor has reviewed and understands the SESC provisions within the plans and specifications. The following checklist will provide Contractors with assistance in creating the SESC Implementation Plan.

The SESC Implementation Plan must include:

1. A written plan or letter demonstrating:
 - The Contractor's means and methods for the implementation of SESC provisions included within the plans and specifications and compliance with the provisions of Part 91 of PA 451 of 1994, as amended.
 - The Contractor's plan for dust control.
 - The Contractor's plan for inspection and maintenance of temporary SESC's.
2. A map, location plan, drawing, or amended copy of the Project SESC or grading plan showing:
 - The locations of any stockpiles of soil associated with the Project
 - The temporary SESC controls associated with stockpiles of soil
 - The Contractor's suggested or proposed additions or relocations of any temporary or permanent SESC's. associated with the Project plans and specifications (subject to approval by Engineer and DTMB)
 - Location of site entrances, exits and vehicle routes
 - Location of site superintendent's/project manager's site trailer or office (for SESC Inspector check-in)
3. A schedule for the installation and removal of temporary controls and the installation of permanent soil erosion and sedimentation controls in relation to the overall construction schedule.

Submit the above items to the above address.

Upon approval of the Contractor's plan, an "Authorization to Proceed with Earth Change" will be issued by DTMB, Design and Construction Division.

DEMOLITION/REMODELING PROJECT PROCEDURES

Furnish all equipment, materials, labor and services necessary to complete all building demolition required in connection with the existing building, in order to permit the installation of new Work. The goal of the Owner is to generate the least amount of waste or debris possible. However, inevitable waste and debris that are generated shall be reused, salvaged, or recycled, and disposal in landfills shall be minimized to the extent economically feasible. The Contractor will be required to prepare waste management plan for the collection, handling, storage, transportation and disposal of the waste generated at the construction site for the Owner's review and approval. The Contractor will be required to produce waste management progress reports.

1. Locations: Notations are made in various places on the Drawings to call attention to building demolition which is required; however, these Drawings are not intended to show each and every item to be removed. The Contractor and the Subcontractors for the various trades must remove the materials related to their respective trades as required to permit the construction of the new Work as shown.
2. Permits: The Contractor must secure from the appropriate agencies all required permits necessary for proper execution of the work before starting work on the project site. All fees for securing the permits must be paid by the Contractor, including all inspection costs which may be legally assessed by the Bureau of Construction Codes in accordance with the authority granted under the Public Act 1980 PA 371, as amended.
3. Enclosures: Where it is necessary to make alterations to walls, floors or roof of the existing building, the Contractor must provide and maintain dustproof partitions to separate the parts where Work is being done from the adjoining parts occupied by the State Agency. Where any parts are opened and exposed to the elements, the Contractor must provide weather tight enclosures to fully protect the structure and its contents.
4. Waste Management Plan: The management plan must address waste source identification and separation, returns, reuse and salvage, recycling, landfill options, alternatives to landfilling, materials handling procedures and transportation.
5. Preparation: Protect all existing Work that is to remain and restore in an approved manner any such Work that becomes damaged.
 - 5.1 Rubbish and debris resulting from the Work must be removed immediately from the site by the Contractor. However, any recyclable materials must be recycled; the Contractor will be required to use alternatives to landfills for waste disposal such as reuse or recycle of asphalt, bricks, concrete, masonry, plastics, paint, glass, carpet, metals, wood, drywall, insulation and any other waste materials to the extent practical.
 - 5.2 Unless otherwise specified, the Agency will remove existing furniture, drapery tracks, draperies, window blinds, and other equipment items, which might interfere with the new construction.
6. Coordination: Demolition work, in connection with any new unit of Work, must not be commenced until all new materials required for completion of that new item of Work are at hand.
7. Waste Management Plan Progress Reports: Submit an updated report with the payment requests. The progress reports shall include:
 - a. The amount of waste sent to a landfill, tipping fees paid and the total disposal cost. Include supporting documents such as manifests, weight tickets, receipts and/or invoices.
 - b. Records for each material recycled/reused/salvaged from the project including the amount, date removed from the job site, final destination, transportation cost, recycled materials and the net cost/ savings.
 - c. Breakdown of waste by type generated to date.
 - d. Recycling/salvage/landfill rates.
 - e. Percent of waste recycled/salvaged to date.

HAZARDOUS MATERIALS PROJECT PROCEDURES

1. The Contractor must use, handle, store, dispose of, process, transport and transfer any material considered a Hazardous Material in accordance with all Federal, State and local Laws. If the Contractor encounters material reasonably believed to be a Hazardous Material and which may present a substantial danger, the Contractor must immediately stop all affected work, give written notice to the Owner of the conditions encountered, and take appropriate health and safety precautions.
2. This project has been identified by the DTMB-SFA as having a possibility of containing Hazardous Waste materials to be legally removed from the Project job site in order to complete the Work as described in the Proposal And Contract. If removal of friable asbestos material is required, the Contractor must contact the Air Quality Division, Department of Environment, Great Lakes, and Energy, at **(517) 284-6773**, for a permit and furnish all training, labor, materials, services, insurance, and equipment necessary to carry out the removal operations of all Hazardous Materials from the Project job site, as identified by the Scope of Work, or encountered on the Project job site, in accordance with State and Federal Hazardous Waste Codes. A Contract Change Order will be written to modify the existing Contract to pay for the additional cost.
3. Environmental Hazards (air, water, land and liquid industrial) are handled by the Waste and Hazardous Materials Division, Michigan Department of Environment, Great Lakes, and Energy (EGLE) in carrying out the requirements of the Federal Environmental Protection Agency (EPA). For general information and/or a copy of the latest regulations and publications call (517) 335-2690.
4. The Michigan Occupational Safety and Health Administration (MIOSHA) provides protection and regulations for the safety and health of workers. The Department of Licensing and Regulatory Affairs provides for the safety of workers. The Department of Community Health provides for the health of workers (517/373-3740) (TDD 517/373-3573).
 - 4.1 Contractor must post any applicable State and/or Federal government regulations at the job site in a prominent location.
 - 4.2 Contractor must be responsible for training their workers in safe work practices and in proper removal methods when coming in contact with hazardous chemicals.
5. Applicable Regulations:
 - 5.1 Natural Resources and Environmental Protection Act – PA 451 of 1994, as amended, including Part 111 – Hazardous Waste Management, Part 121 – Liquid Industrial Waste and Part 147 – PCB compounds.
 - 5.2 RCRA, 1976 - Resource Conservation and Recovery Act: This federal statute regulates generation, transportation, treatment, storage or disposal of hazardous wastes nationally.
 - 5.3 TSCA, 1979 – Toxic Substances Control Act: This statute regulates the generation, transportation, storage and disposal of industrial chemicals such as PCBs.
6. Definitions: Hazardous substances are ignitable, corrosive, reactive, and/or toxic, based on their chemical characteristics.
 - 6.1 Under Federal and Michigan Law, a Small Quantity Generator of hazardous waste provides from 220 to less than 2,000 lbs./month or never accumulates 2,200 lbs. or more.
 - 6.2 A Generator size provider of hazardous waste provides 2,200 lbs. or more/month or accumulates above 2,200 lbs.
7. Disposals: To use an off-site hazardous waste disposal facility, the Contractor must use the Uniform Hazardous Waste Manifest (shipping paper). Small quantities of hazardous waste may not be disposed of in sanitary landfills used for solid waste.
8. Federal, State and local Laws and regulations may apply to the storage, handling and disposal of Hazardous Materials and wastes at each State Agency. Contact the **Environmental Assistance Center** of the Michigan Department of Environment, Great Lakes, and Energy (EGLE) at **1-800-662-9278**, Fax to: 517-241-0673 or e-mail to: DEQ-EAD-env-assist@michigan.gov for general EGLE information including direct and referral assistance on air, water and wetlands permits; contaminated site clean-ups; underground storage tank removals and remediation; hazardous and solid waste disposal; pollution prevention and recycling; and compliance-related assistance. The Center provides businesses, municipalities, and the general public with a single point of access to EGLE's environmental programs.

ASBESTOS ABATEMENT PROJECT PROCEDURES

Should this Work require the renovation or demolition of a building or structure initially constructed on or prior to 1980, the Contractor will use the attached copy of a Comprehensive Asbestos Building Survey for those portions of the building or structure being impacted and must plan his or her work to minimize disturbance of any known or assumed asbestos containing materials (ACM). In addition, if this building or structure was constructed on or prior to 1980, the Contractor's On-Site Superintendent and all Subcontractor On-Site Superintendents for trades that could potentially disturb known or assumed ACM, must, as a minimum, have and provide documentation of current Asbestos Awareness Training.

If the Comprehensive Asbestos Building Survey identifies known or assumed ACM that will potentially be disturbed as a part of the Contractor's renovation or demolition activities, the Contractor must remove, transport and dispose of these materials at no additional cost to the Owner and prior to any other work taking place within the immediate vicinity of said material. If required, the Contractor must provide the Owner a minimum of 10 working day notification prior to the start of any asbestos abatement activities with abatement in occupied buildings being completed even if they will be conducted during off hours (nights, weekends and state holidays).

If the Contractor encounters a suspected ACM that was not previously identified within the Comprehensive Asbestos Building Survey, the Contractor must immediately stop all affected work, give written notice to the Owner of the conditions encountered, and take appropriate health and safety precautions. If, after providing Owner notification, the Contractor is directed to sample and/or remove the suspected ACM in question, a Contract Change Order will be written to modify the existing Contract to pay for the additional cost. Any abatement shall be completed in accordance with the requirements of this Section.

If removal of ACM is required, removal must be completed by a contractor currently licensed to remove asbestos by the State of Michigan, Department of Licensing and Regulatory Affairs (DLARA) Asbestos Program and abatement must be performed in accordance with all Federal, State and local Laws and Regulations. Prior to commencing any asbestos abatement activities, the licensed abatement contractor must submit, as required by Federal, State and Local Laws and Regulations, a "Notification of Intent to Renovate/Demolish" to both the State of Michigan, Department of Environment, Great Lakes, and Energy (EGLE), Air Quality Division and to the DLARA, Asbestos Program, to comply with National Emission Standards for Hazardous Air Pollutants (NESHAP), and the Clean Air Act (CAA). All regulated ACM must be disposed of at an approved Type II (general refuse) landfill and must be in leak-tight wrapping or containers. ACM that is non friable and is not in poor condition or will not become regulated ACM at any time can be disposed of in a Type III (construction debris) landfill.

At the completion of each abatement activity, the Contractor must perform clearance testing in accordance with National Institute for Occupational Safety and Health (NIOSH) 582 "Sampling and Evaluating Airborne Asbestos Dust". All air samples shall indicate concentrations of less than 0.01 fibers/cc for clearance to be met. Clearance testing shall be performed by a third party Asbestos Consultant. The Asbestos Consultant selected by the Contractor shall be experienced and knowledgeable about the methods for asbestos air sampling and be able to select representative numbers and locations of samples. It is mandatory that the Asbestos Consultant's on-site hygienist performing sampling and analysis have certification that he/she has passed a NIOSH 582 or equivalent course.

The NESHAP asbestos regulations, notification form, guidelines and fact sheets are available on EGLE's web site www.michigan.gov/egle under heading Air; then click on Compliance; then click on Asbestos NESHAP Program. For guidelines on submitting notifications pursuant to the Asbestos Contractors Licensing Act, contact the DLARA, Occupational Health Division, Asbestos Program at (517) 322-1320 or visit DLARA's web site www.michigan.gov/asbestos.

LEAD ABATEMENT PROJECT PROCEDURES

Should this Work require the renovation or demolition of a building or structure, the workers are assumed to be exposed to lead or materials containing lead above acceptable levels until proven otherwise through personal air sampling and analysis. The Contractor shall take all steps necessary to assure that his/her employees, are not exposed to lead at concentrations greater than the Permissible Exposure Limit as per the State of Michigan Department of Licensing and Regulatory Affairs Occupational Health Standards Part 603 "Lead Exposure in Construction". In addition, the Contractor shall convey this same requirement to all subcontractors that may be under his/her control.

The employer shall comply with the Michigan Lead Abatement Act, as amended, and the Lead Hazard Control rules and must communicate information concerning lead hazards according to the requirements of Michigan Occupational Safety and Health Administration (MIOSHA) Part 603 and the Occupational Safety and Health Administration's (OSHA's) Hazard Communication Standard for the construction industry, 29 CFR 1926.59, including but not limited to safety equipment (e.g. personal fit-tested and approved respirators and protective clothing), worker rotation (on a short-cycle and regular basis), working practices (e.g. sanding, cutting, grinding, abraded, burning and heat-gun stripping of lead based paint are not allowed), the requirements concerning warning signs and labels, Safety Data Sheets (SDS), and employee information and training. Employers shall comply with the requirements of 29 CFR 1926.62(l) - Employee Information and Training.

If lead or materials containing lead will be disturbed as a part of the work to be performed, the Contractor must remove, transport and dispose of these materials at no additional cost to the Owner and prior to any other work taking place within the immediate vicinity of said material. The Contractor must provide the Owner a minimum 10 working day notification prior to the start of any lead abatement activities with abatement in occupied buildings being completed even if they will be conducted during off hours (nights, weekends and state holidays). Abatement is defined as an activity specifically designed to permanently remove lead paint, lead-contaminated dust or other lead containing materials, the installation of a permanent enclosure or encapsulation of lead paint or other lead containing materials, the replacement of lead-painted surfaces or fixtures, the removal or covering of lead-contaminated soil, and any preparation, cleanup, disposal and post-abatement clearance testing associated with these activities. Renovation, remodeling, landscaping, or other activity, that is not designed to permanently eliminate lead paint hazards, but is instead designed to repair, restore, or remodel a structure, or housing unit even though the activity may incidentally result in a reduction or elimination of a lead paint hazard is not considered abatement.

If abatement of lead or materials containing lead is required, abatement must be completed by a currently certified Lead Abatement Contractor as certified by the State of Michigan, Department of Community Health. In addition, the Lead Abatement Contractor's workers and supervisors must also be currently certified by the State of Michigan, Department of Community Health. Lead abatement including clearance testing shall be performed in accordance with the State of Michigan, Lead Abatement Act, Part 54A Lead Abatement and with all other Federal, State and local Laws and Regulations that may apply. Prior to commencing any lead abatement activities, the abatement must be designed by a currently certified Lead Professional Project Designer. At the completion of abatement, the abated area shall meet clearance requirements with clearance testing to be performed by a Clearance Technicians currently certified by the State of Michigan Department of Community Health.

For additional information about certifications, guidance and regulations for lead hazard control activities, visit www.michigan.gov/leadsafe.






APPENDIX IV

PROJECT SIGN FOR PROJECTS COSTING IN EXCESS OF \$500,000

-N/A-

PROJECT SIGNS – PROJECTS IN EXCESS OF \$500,000

Five examples of project signs. Sign lettering corresponds with the funding arrangement of the project. Alternate signs may be considered; please contact the DTMB Project Director.

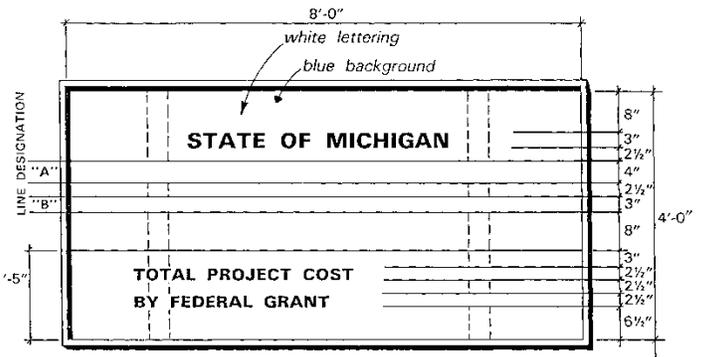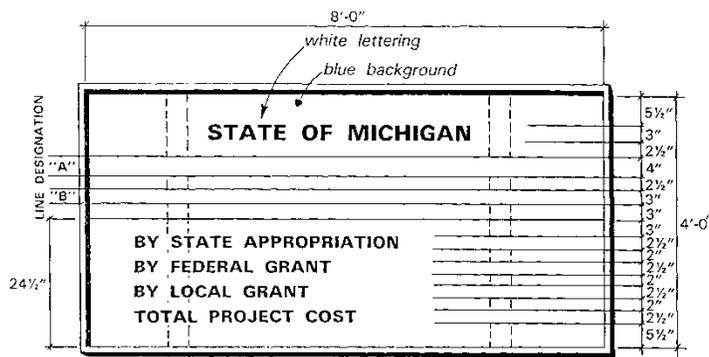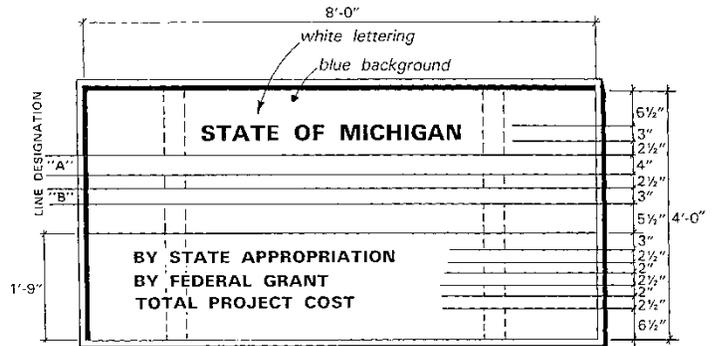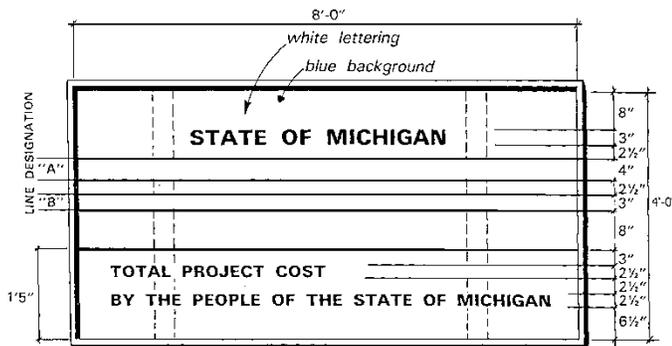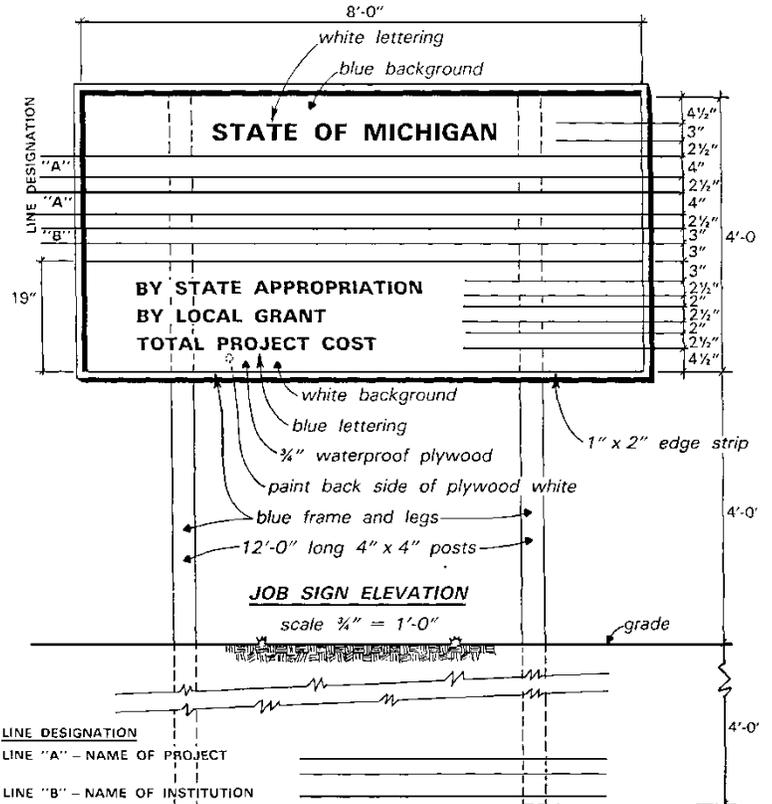

APPENDIX V
PREVAILING WAGE RATES

-N/A-

**LUCE - MACKINAC - ALGER - SCHOOLCRAFT
DISTRICT HEALTH DEPARTMENT**

Permit Number S21-49

Authorization: Sewage Treatment System Permit Reason: Existing Development: New (Not Interconnected)

Use: Non-Residential

Legal Description: County: Luce T 45 N R 11 W SEC 31

Township Lakefield Site Address: COUNTY ROAD 135

Property Description #: 48-002-001-031-4000

Business Name/OwnerName: COUNTY LINE BOAT LAUNCH

Address: 41382 W. M-123 City: PARADISE State: MI Zip: 49768

SEWAGE SITE CRITERIA:

Topography: Slight

Limiting Layer Type: Water Table

Depth to Limiting Layer: 4 ft. in.

Residential # of Bedrooms: 0 Garbage Disposal No

Sewage Flow: gpd

Soil Type: Silty Clay, Clay

Loading Rate: gpd/sq. ft.

SEWAGE SYSTEM DESIGN CRITERIA:

Approved for Conventional System?

System Type: Vault Privy

Locate System at Test Hole:

Fill Beneath Field: ft. in.

Septic Tank Volume: 1000 gal. New Existing

Absorption Field Area: sq.ft.

Aggregate Cover:

SEWAGE SPECIAL CONSTRUCTION PRACTICES:

This is a replacement of existing vault privy. Have the existing tank pumped by a licensed hauler and remove the old outhouse and vault. Proposed privy location meets the 75ft required isolation to the nearest surface water body, which is the lake. See site eval for proposed privy location. Install in accordance with the Superior Code. Tank must be a minimum 1000 gallon capacity, vented above the roof, and water-tight tested with test documentation submitted. Final inspection is required upon completion, call 906-293-5107 to schedule.

WATER SUPPLY CRITERIA

Well Type:

Pump Type:

Suction Line Protection Method:

Existing Well(s)?

Existing Well to be Abandoned:

USE OF EXISTING WELL NOT

WELL SPECIAL CONSTRUCTION PRACTICES

Permit Issued By: NatalieKentner

Signature: Natalie Kentner

Permit Issue Date: 3/8/2021

Fees:

Permit Expires: 3/8/2023

Comments:

SITE EVALUATION - FOR SANITARIAN/CONSULTANTS USE

Property ID: 48 - 002 - 001 - 031 - 4000

T 45N R 11W SEC. 31


Owners Name: County Line Boat Access Site – State of Michigan DNR

Property Size: 2.5 Acres (Dimension or Acreage)

INCLUDE IN DRAWING:

- Property Dimensions
- Well(s)
- All Structures with Dimensions
- Easements
- Roads
- Driveways
- Surface water (lakes, streams, rivers, pond)
- Existing Septic System (if applicable)
- Fuel Tanks
- Utilities
- Distances between all of the above
- Test Hole Location(s)
- Replacement Area (RA)

NOT TO SCALE

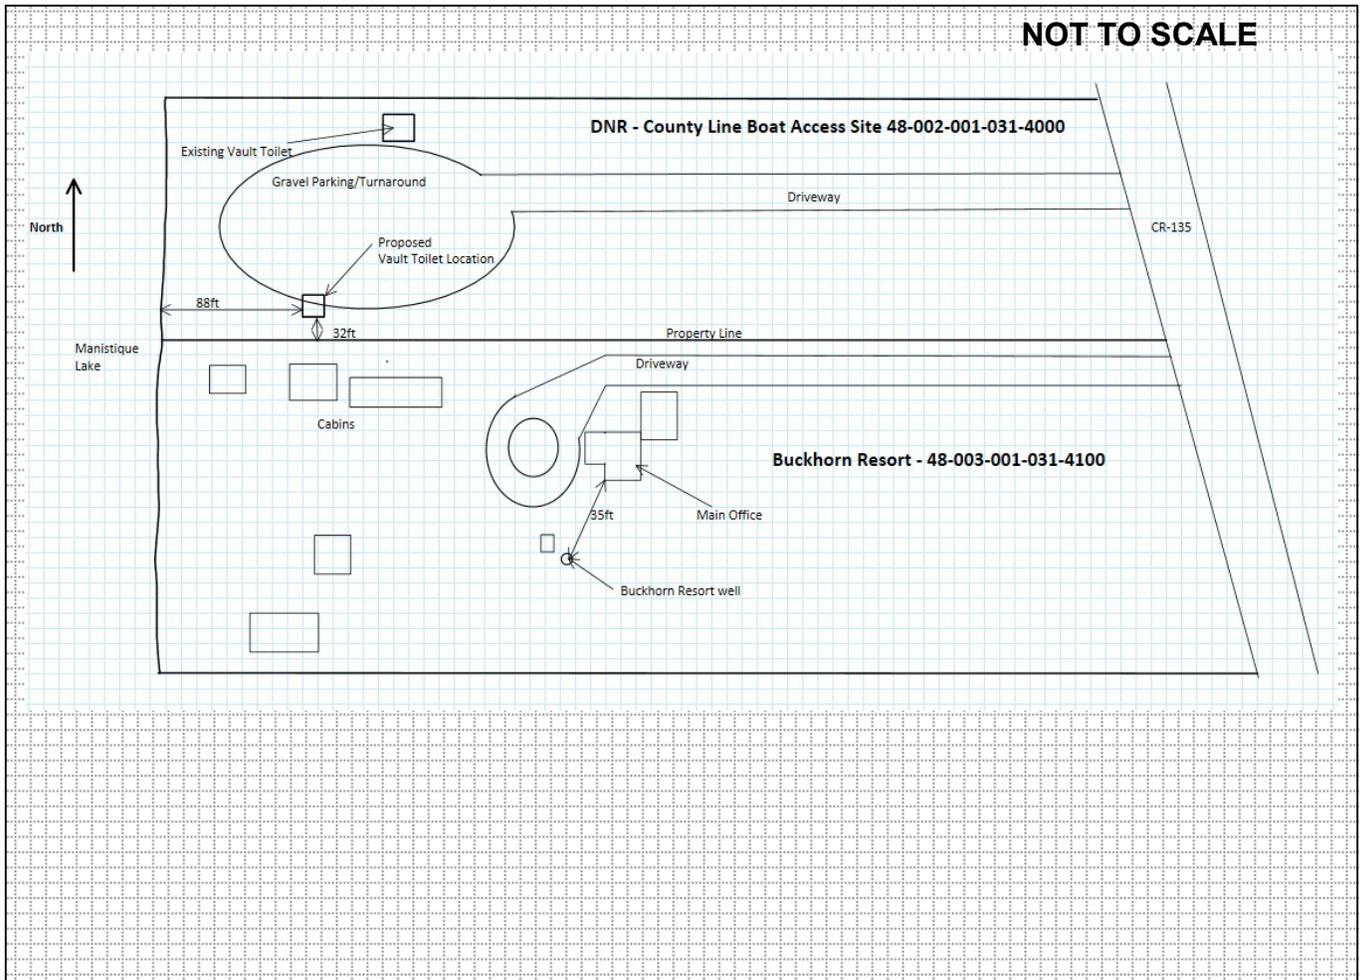

Topography: <input checked="" type="checkbox"/> Slight <input type="checkbox"/> Moderate <input type="checkbox"/> Severe	Existing Well? <input type="checkbox"/> Y <input checked="" type="checkbox"/> N	Site: NA <input type="checkbox"/> Approved <input type="checkbox"/> Denied, alt. options <input type="checkbox"/> Y <input type="checkbox"/> N
	To Be Abandoned? <input type="checkbox"/> Y <input checked="" type="checkbox"/> N	for conventional sewage treatment system
Benchmarks: NA	Municipal Water? <input type="checkbox"/> Y <input checked="" type="checkbox"/> N	as established in Superior Code 5.7.1 (1)(c) .
Soils consistent across site: <input type="checkbox"/> Y <input checked="" type="checkbox"/> N Replacement area location: NA Fill needed: <input type="checkbox"/> Yes <input type="checkbox"/> No		

Comments: Application for vault privy at County Line Boat Access Site owned by the MDNR. No water supply present. Proposed vault toilet installation on south side of property. Vault proposed at 1000 gallons – concrete septic tank manufactured by Bichler. Location is greater than 75ft from the lake. Existing vault toilet on north side of property will be removed. Verified no wells within 75ft of proposed vault toilet location on the neighboring Buckhorn Resort property to the south.

SANITARIAN Natalie Kentner	Date: 3/3/2021
----------------------------	----------------